## GENERAL NOTES - PIPING

1. FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M00-00.
2. FOR PROJECT DESIGN CRITERIA SEE DRAWING M00-01.
3. PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
4. VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
5. ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 885

## KEYNOTE LEGEND

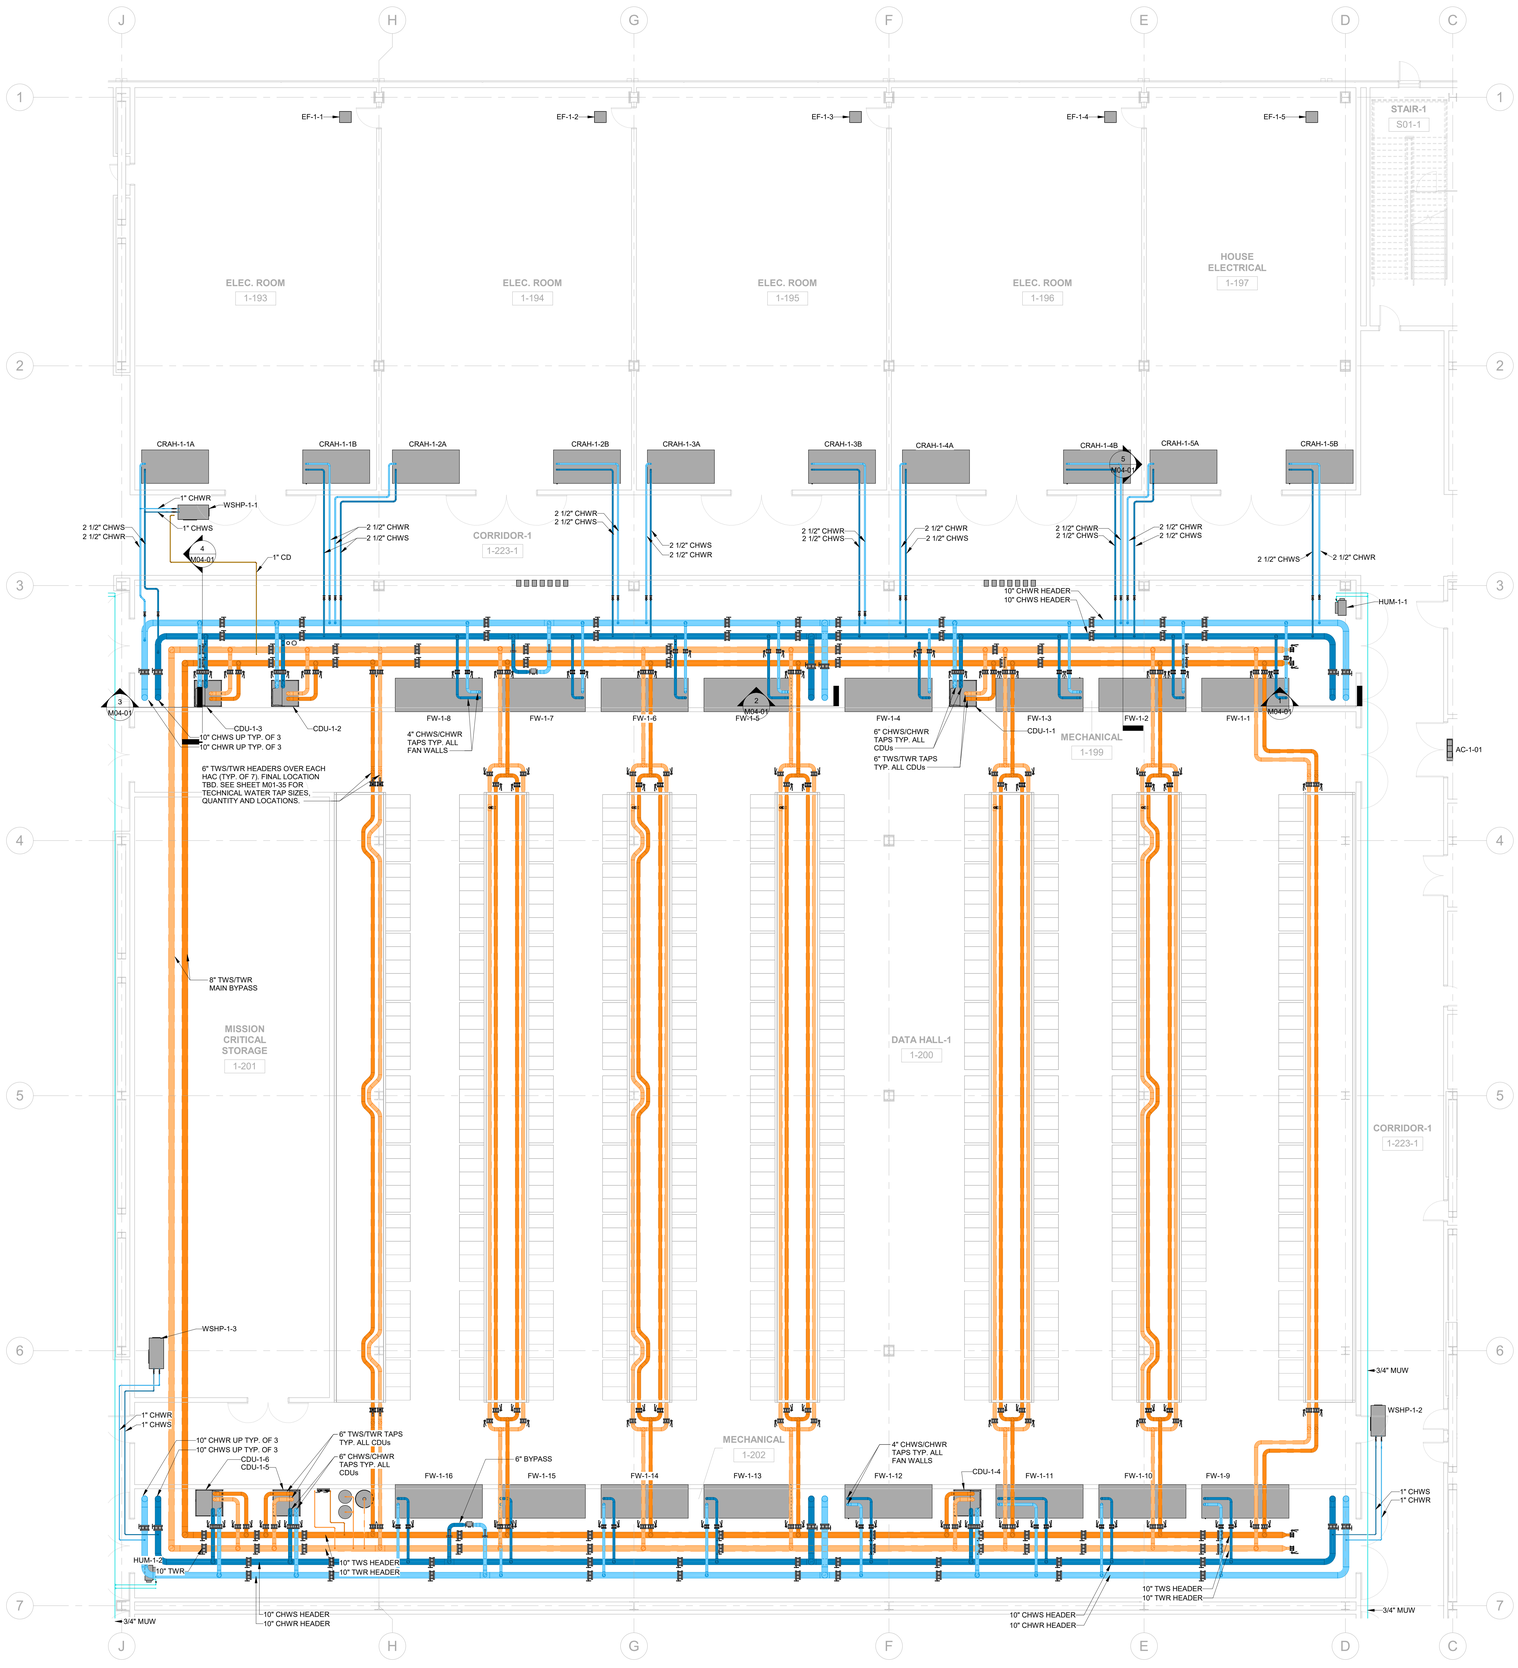


1 LEVEL 1 - MECHANICAL PIPING PLAN - SEGMENT C
1/8" = 1'-0"

serverfarm
CORGAN
TGRWA STRUCTURAL ENGINEERS
kW Mission Critical Engineering Member of WSP
EP ENGINEERING PLUS
Kimley»Horn

| ISSUES | | |
|---|---|---|
| 1 | 11.12.2025 | CONCEPTUAL DESIGN |
| 2 | 12.12.2025 | SCHEMATIC DESIGN |
| 4 | 1.23.2026 | DESIGN DEVELOPMENT |

REVISIONS


kW Mission Critical Engineering
Contact: K. DREWNOWSKI Phone: 601.451.2099
Engineer: K. COOPER
License #: 23615 Exp. Date: 00/00/0000


NOT FOR CONSTRUCTION

Date: 12/12/2025

SERVERFARM

Clarksville, AR

| | | | |
|---|---|---|---|
| L | K | J | |
| G | E | C | A |
| H | F | D | B |
| P | N | M | |

LEVEL 1 - MECHANICAL PIPING PLAN - SEGMENT C

**JOB** US0049903.5614
**SHEET**

M03-01C

1/23/2026 3:34:38 PM M03-01C LEVEL 1 - MECHANICAL PIPING PLAN - SEGMENT C