

- GENERAL NOTES - PIPING**
- FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M00-00.
 - FOR PROJECT DESIGN CRITERIA SEE DRAWING M00-01.
 - PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
 - VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
 - ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 855.

ISSUES	
2	12.12.2025 SCHEMATIC DESIGN
4	1.23.2026 DESIGN DEVELOPMENT


REVISIONS	

KW Mission Critical Engineering
 Contact: K. DREWNOWSKI Phone: 601.451.2099
 Engineer: K. COOPER License #: 23915 Exp. Date: 00/00/0000

NOT FOR CONSTRUCTION

Date: 12/12/2025


SERVERFARM
Clarksville, AR



LEVEL 2 - MECHANICAL PIPING PLAN - OVERALL

JOB SHEET US0049903.5614

M03-02

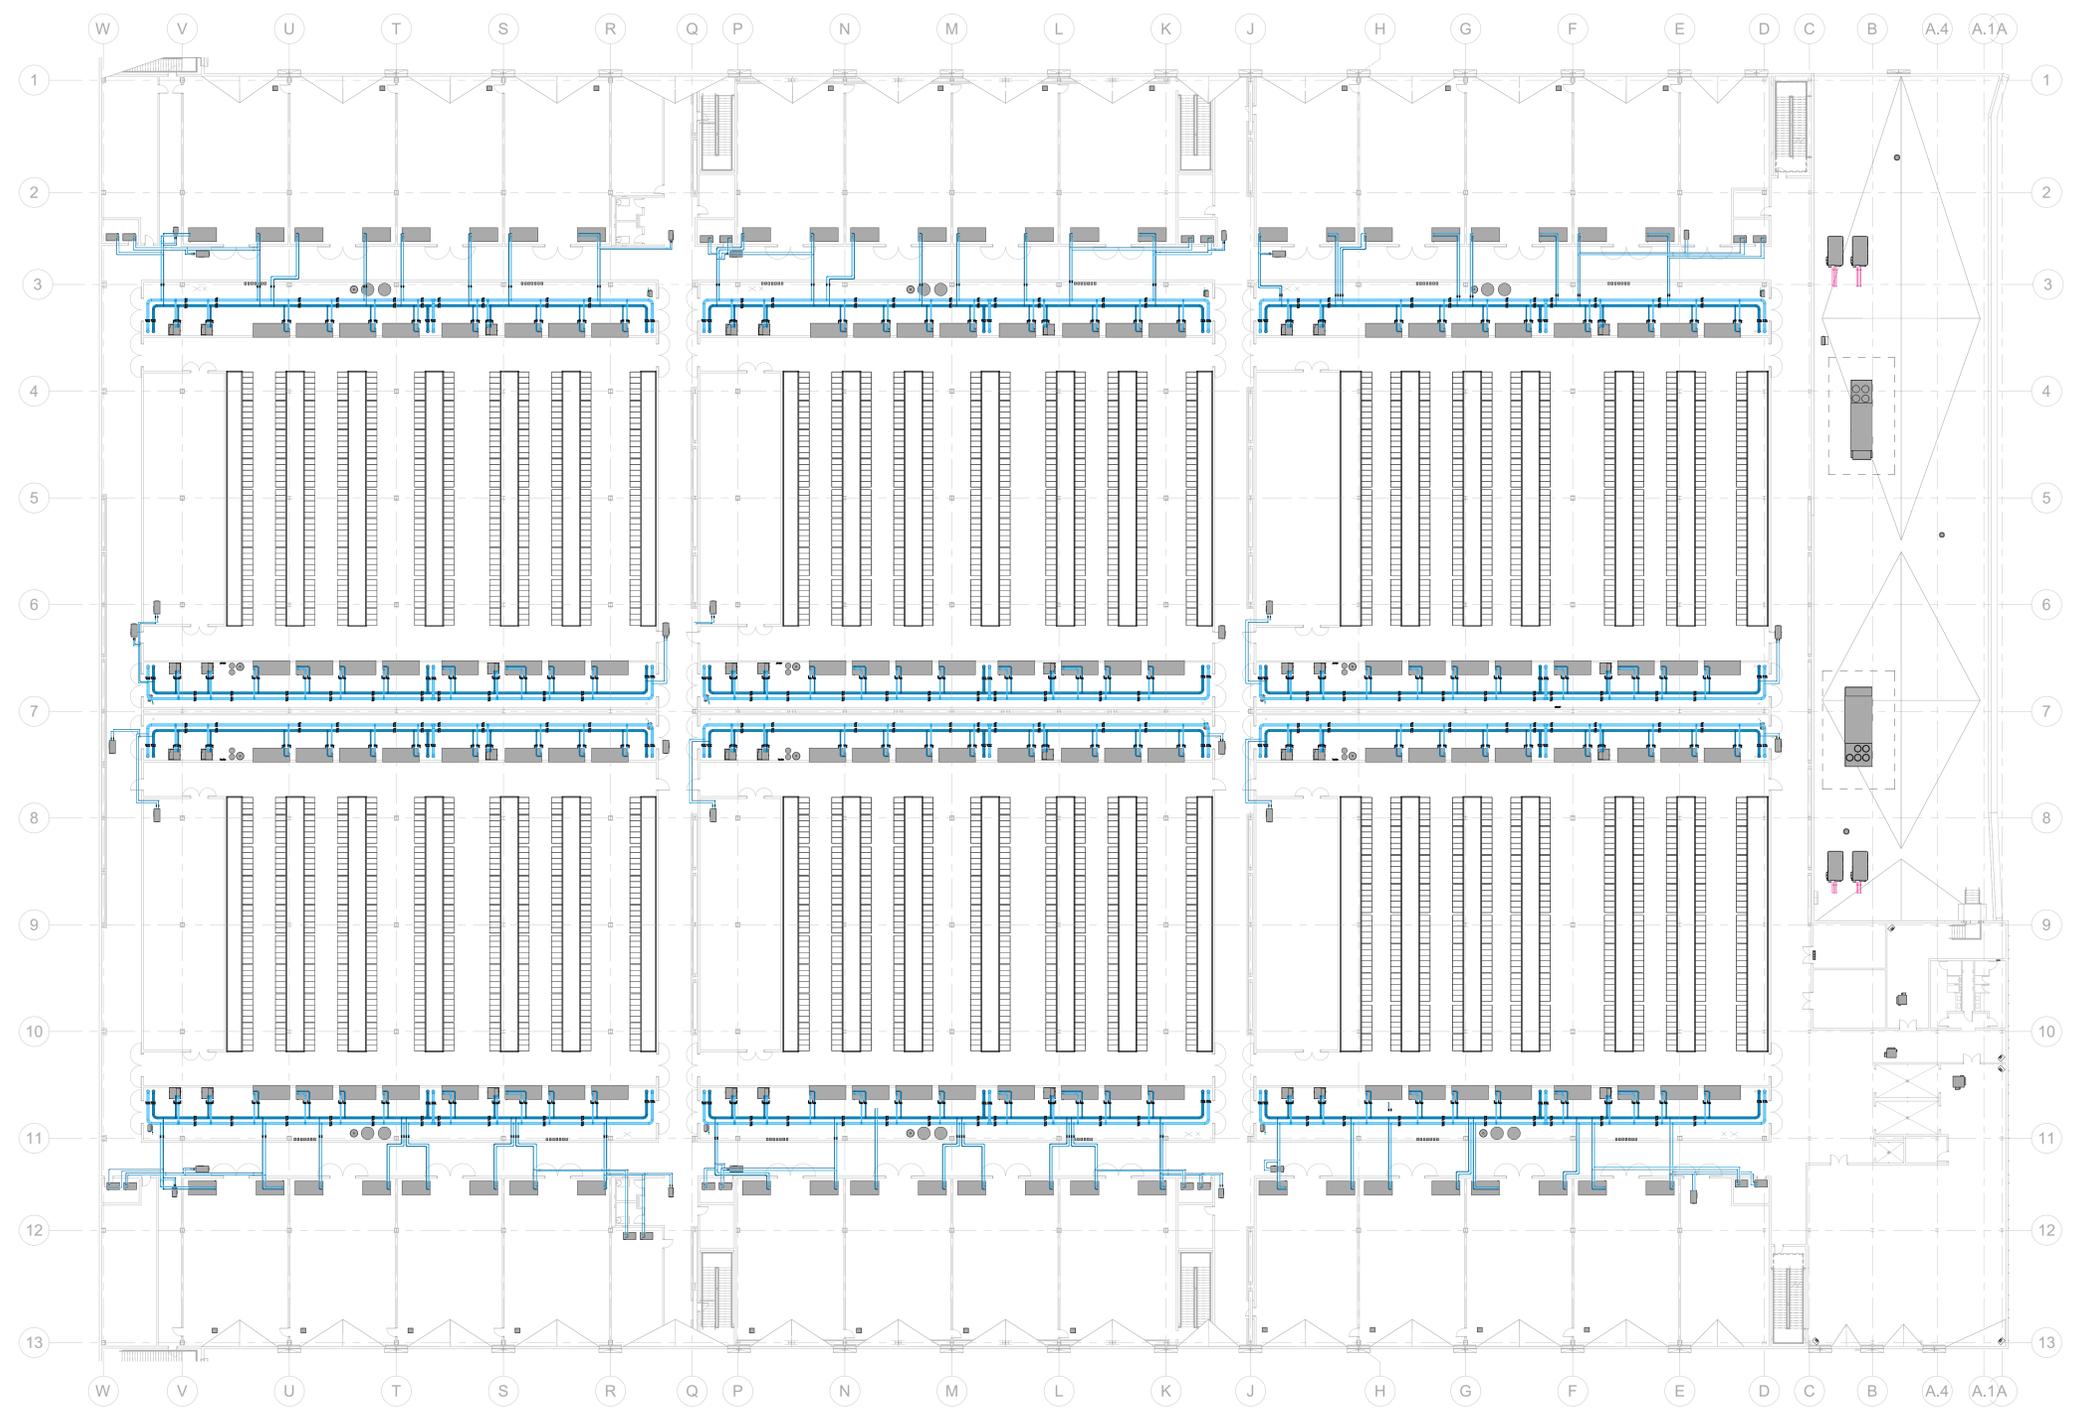

1 LEVEL 2 - MECHANICAL PIPING PLAN - OVERALL
3/64" = 1'-0"

1/23/2026 3:38:39 PM M03-02 LEVEL 2 - MECHANICAL PIPING PLAN - OVERALL