

- GENERAL NOTES - PIPING**
- FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M00-00.
  - FOR PROJECT DESIGN CRITERIA SEE DRAWING M00-01.
  - PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
  - VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
  - ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 855.

**KEYNOTE LEGEND**

**ISSUES**

NO.	DATE	DESCRIPTION
4	1.23.2026	DESIGN DEVELOPMENT

**REVISIONS**

NO.	DATE	DESCRIPTION
-----	------	-------------

KW Mission Critical Engineering  
 Contact: K. DREWNOWSKI Phone: 601.451.2099  
 Engineer: K. COOPER License #: 23615 Exp. Date: 00/00/0000

**NOT FOR CONSTRUCTION**  
 Date: 12/12/2025


**SERVERFARM**  
 Clarksville, AR

L	K	J
G	E	C
H	F	D
P	N	M

**LEVEL 2 - MECHANICAL PIPING PLAN - SEGMENT B**

**JOB SHEET** US0049903.5614

**M03-02B**

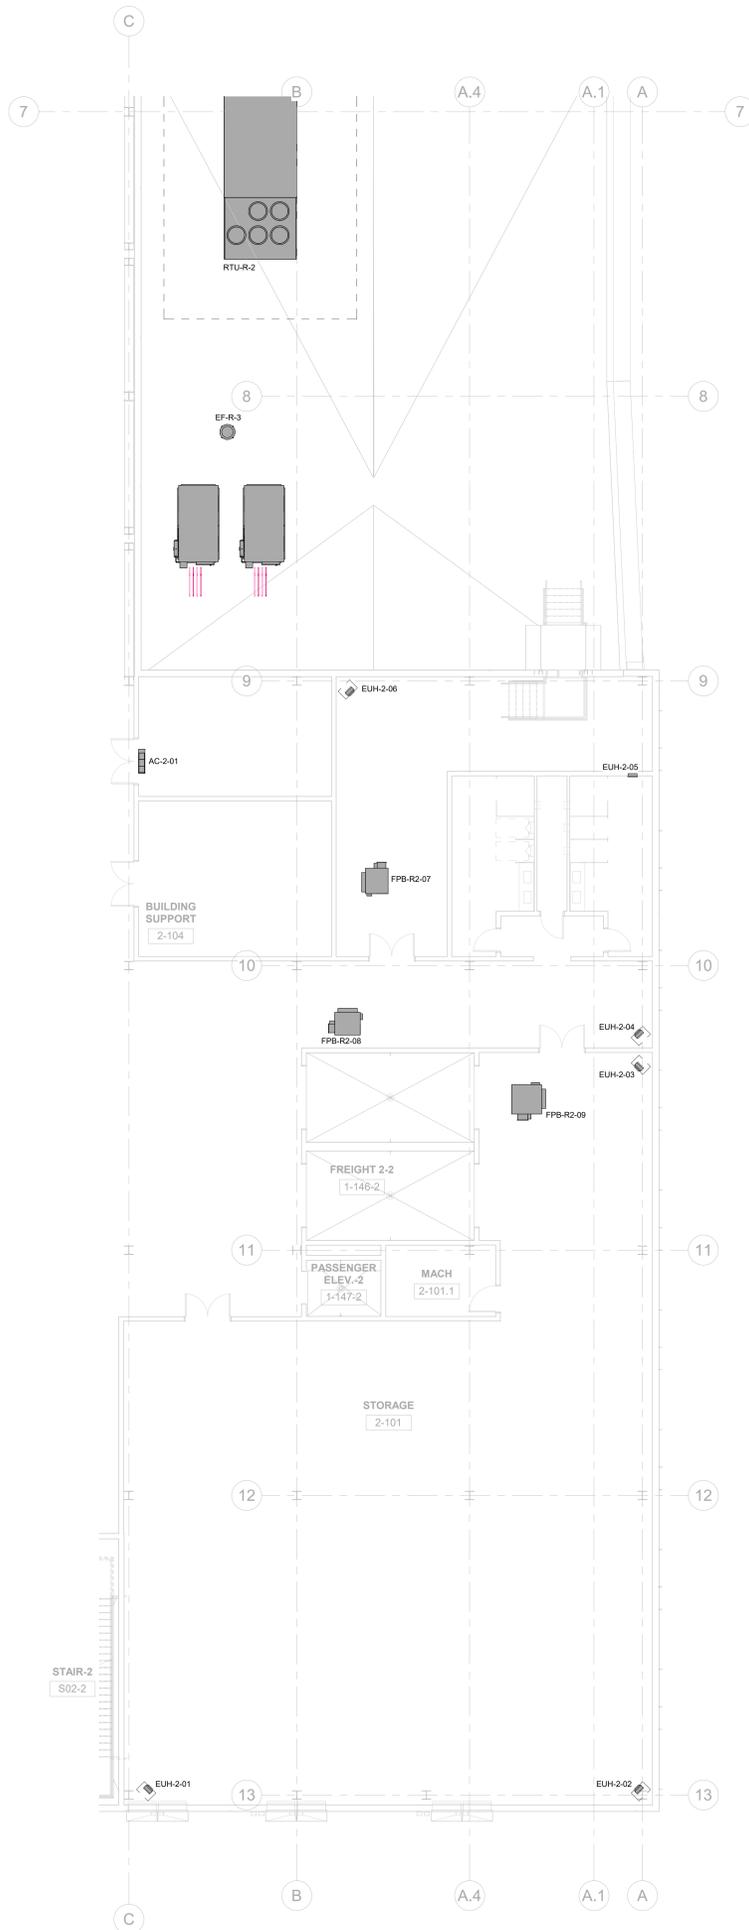

**1 LEVEL 2 - MECHANICAL PIPING PLAN - SEGMENT B**  
 1/8" = 1'-0"

1/23/2026 3:39:33 PM M03-02B LEVEL 2 - MECHANICAL PIPING PLAN - SEGMENT B