

- GENERAL NOTES - PIPING**
- FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M03-00.
 - FOR PROJECT DESIGN CRITERIA SEE DRAWING M03-01.
 - PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
 - VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
 - ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 855.

ISSUES	
2	12.12.2025 SCHEMATIC DESIGN
4	1.23.2026 DESIGN DEVELOPMENT

REVISIONS	

KW Mission Critical Engineering
Contact: K. DREWNOWSKI Phone: 601.451.2099
Engineer: K. COOPER License #: 23615 Exp. Date: 00/00/0000

NOT FOR CONSTRUCTION


Date: 12/12/2025

SERVERFARM
Clarksville, AR

L	K	J	
G	E	C	A
H	F	D	B
P	N	M	

EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT D
JOB US0049903.5614
SHEET

M03-04D

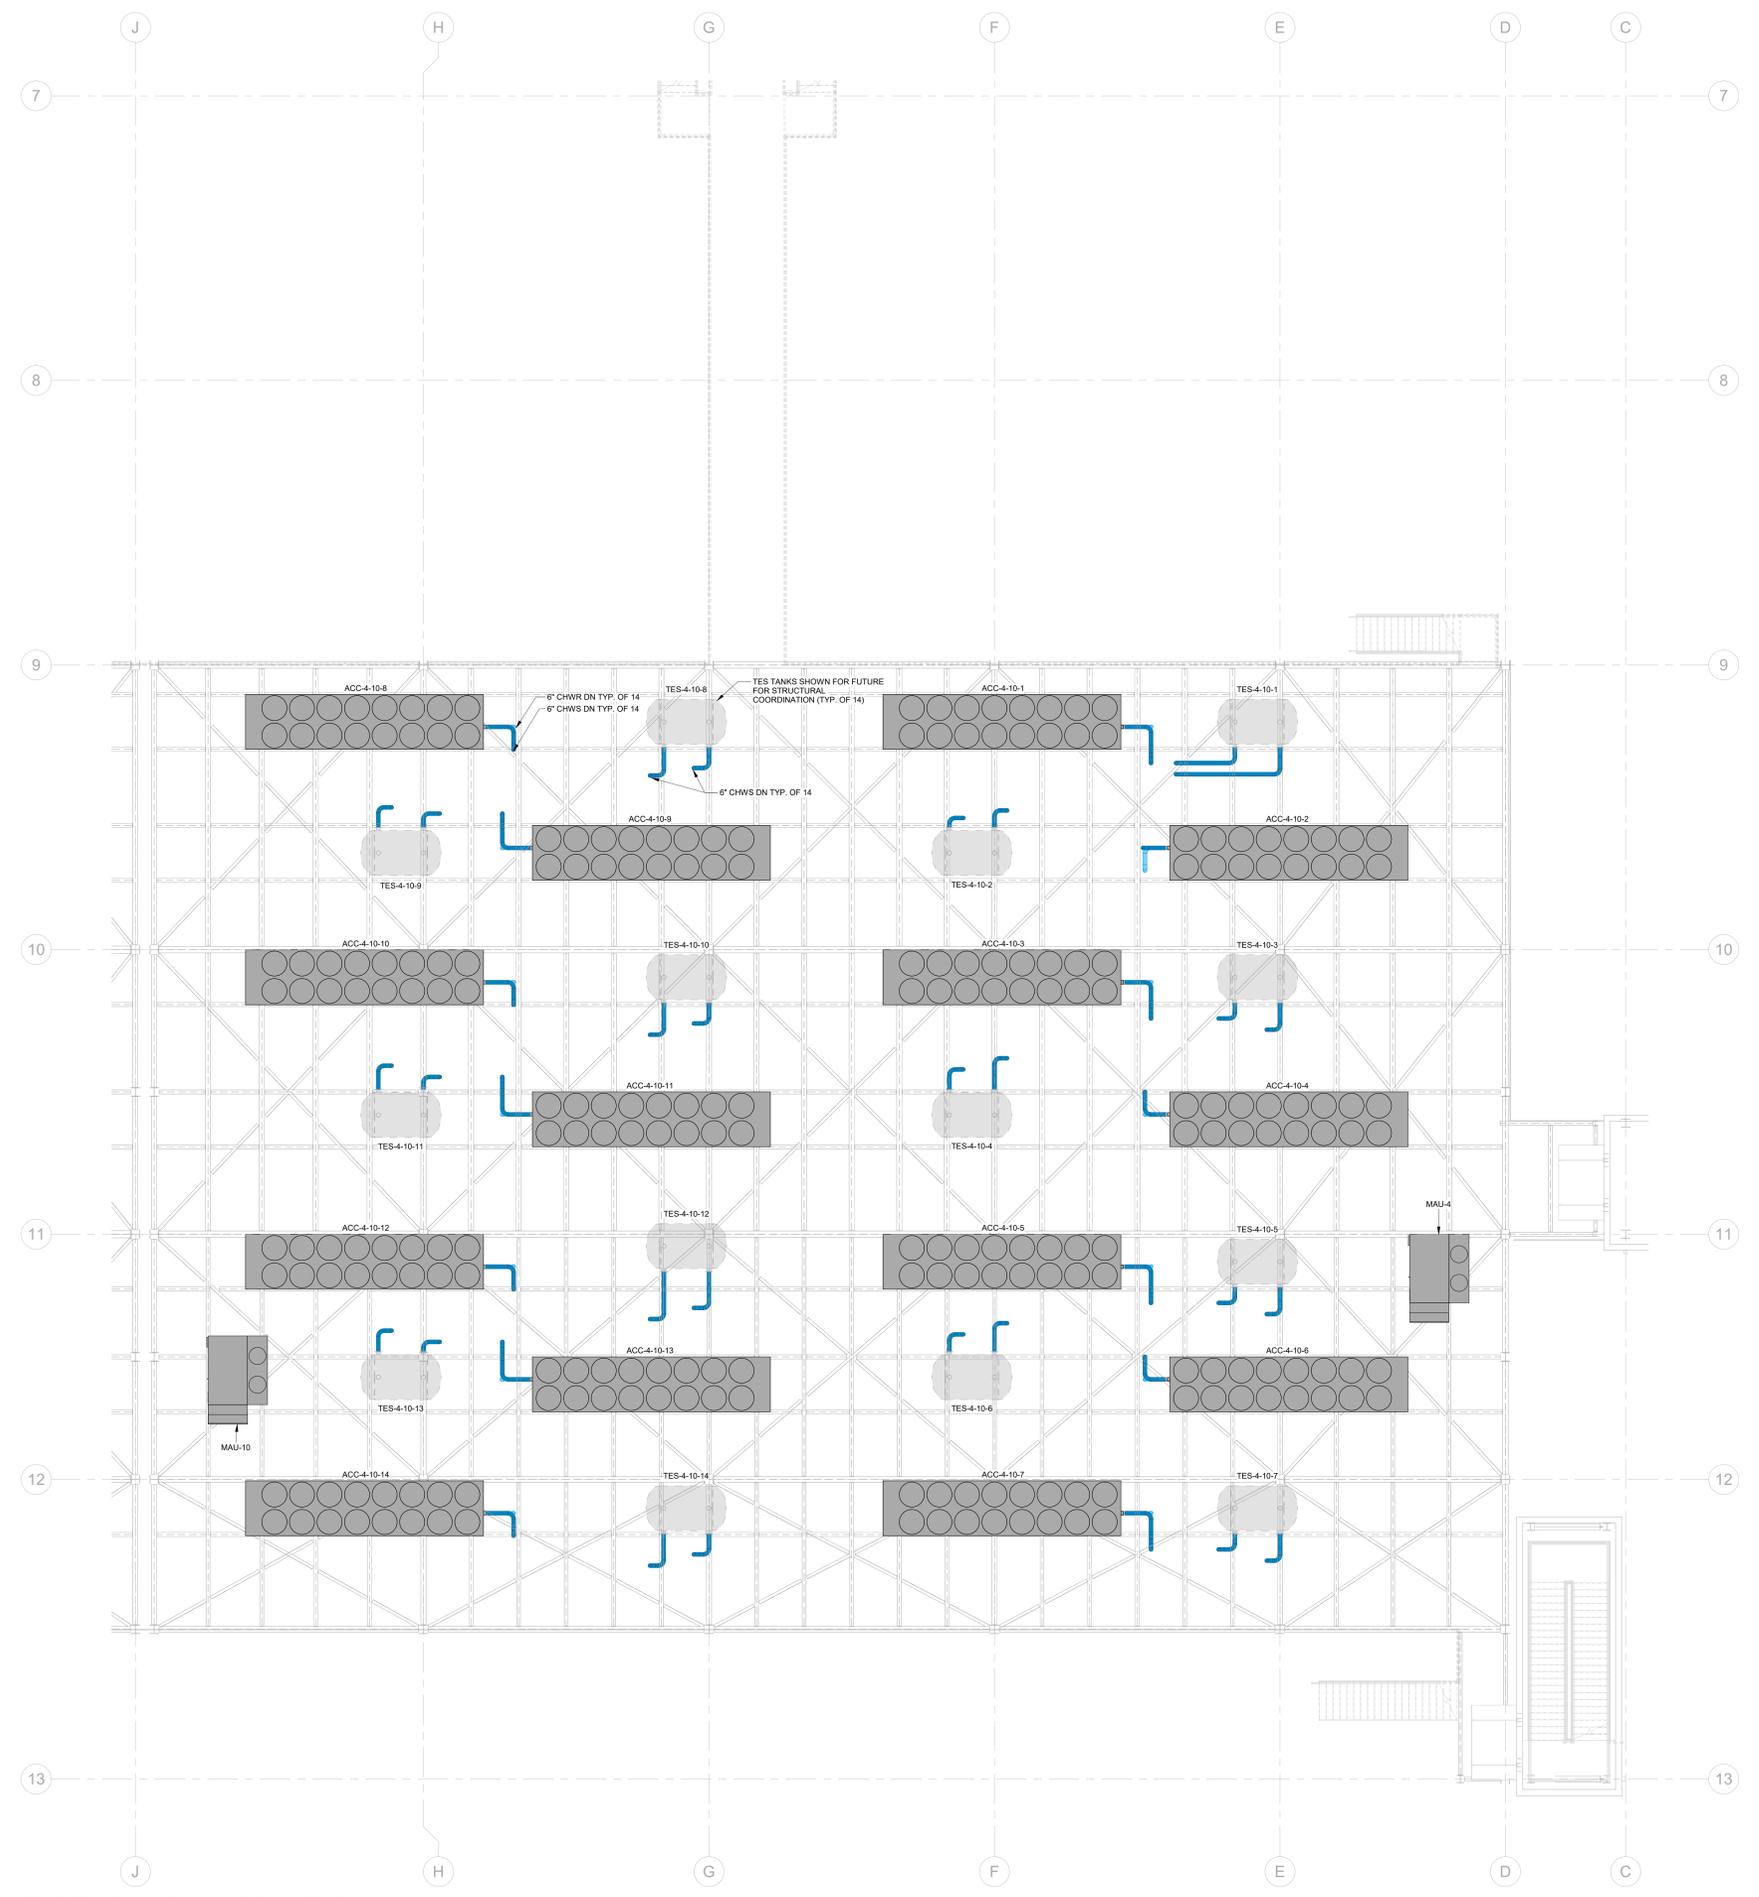

1 EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT D
1/8" = 1'-0"

1/23/2025 3:49:08 PM M03-04D-EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT D