


GENERAL NOTES - PIPING

- FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M03-00.
- FOR PROJECT DESIGN CRITERIA SEE DRAWING M03-01.
- PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
- VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
- ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 855.

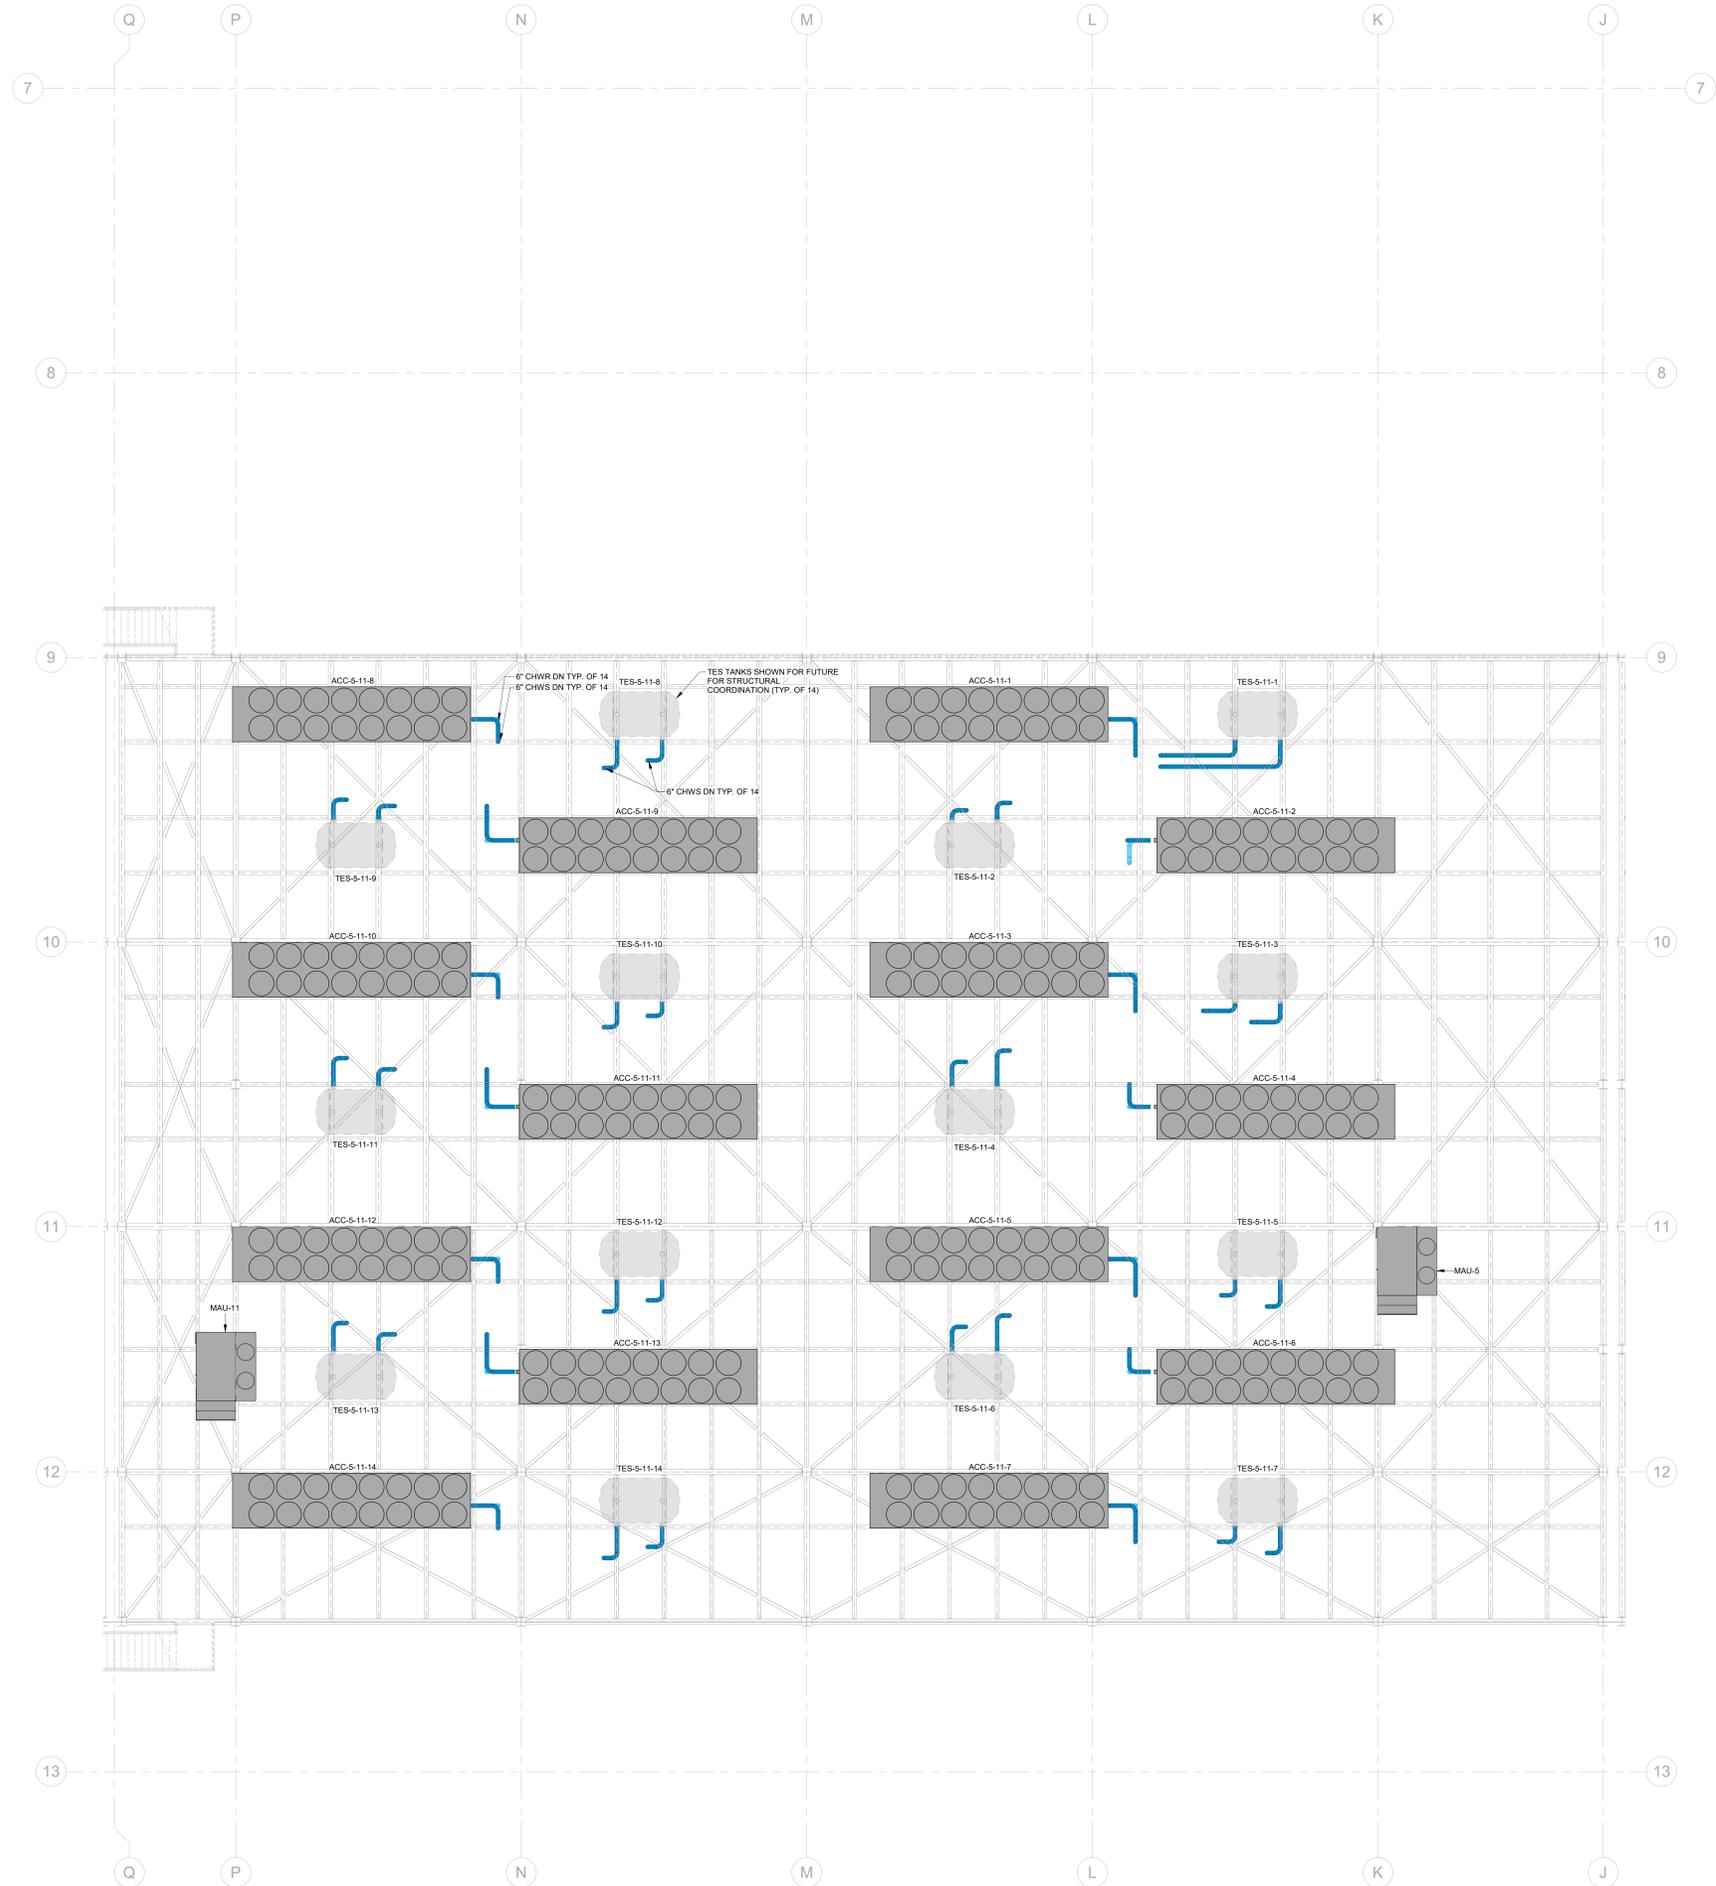

ISSUES	
2	12.12.2025 SCHEMATIC DESIGN
4	1.23.2026 DESIGN DEVELOPMENT

REVISIONS	

kW Mission Critical Engineering
 Contact: K. DREWNOWSKI Phone: 601.451.2099
 Engineer: K. COOPER License #: 23615 Exp. Date: 00/00/0000

NOT FOR CONSTRUCTION

Date: 12/12/2025

SERVERFARM
 Clarksville, AR



EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT F
 JOB US0049903.5614
 SHEET

1/23/2026 3:50:01 PM M03-04F EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT F

1 EQUIPMENT PLATFORM - MECHANICAL PIPING PLAN - SEGMENT F
 1/8" = 1'-0"