

FIRE ALARM DETECTION LEGEND	
	<b>ADMIN, STORAGE, SUPPORT, LOADING DOCK, CORRIDORS, STAIRS</b> CODE MINIMUM DETECTION ONLY NEEDED FOR ELEVATOR RECALL AND SHUNT TRIP, ALARM PANELS, DOOR RELEASE, ETC.
	<b>DATA HALL</b> ASSD AT CEILING AND STRUCTURE - EARLY WARNING FIRE DETECTION. ASSD SPACING TO BE 400 SQ FT.
	<b>GALLERY</b> ASSD AT STRUCTURE - EARLY WARNING FIRE DETECTION. ASSD SPACING TO BE 400 SQ FT.
	<b>ELECTRICAL CONTAINERS, UPS ROOMS</b> ASSD DETECTION PROVIDED BY CONTAINER MANUFACTURER. FIRE ALARM CONTRACTOR TO MONITOR ASSD BACK TO THE BASE BUILDING FACP.
	<b>IDF, POE, MMR, HOUSE ELEC, PREACTION ZONE SUPPORT SPACES</b> SPOT TYPE DETECTION AT STRUCTURE OR CEILING AS APPLICABLE.
	<b>MECHANICAL EQUIPMENT</b> DUCT DETECTORS IN AIR HANDLING UNITS GREATER THAN 2000 CFM.
	<b>GENERATOR ROOMS</b> HEAT DETECTION AT STRUCTURE.
	<b>SHELL SPACE</b> BEAM DETECTORS.
	<b>SHELL SPACE, GENERATORS</b> NO DETECTION REQUIRED.


ISSUES	
1	
2	12.12.2025 SCHEMATIC DESIGN
3	01.23.2026 60% DESIGN DELIVERABLE

REVISIONS	

KW Mission Critical Engineering  
 Contact: Stephan Slatkicky Phone: 212.951.3943  
 Engineer: EOR License #: 123456 Exp. Date: 00/00/0000

**NOT FOR CONSTRUCTION**  
 Date: 00/00/0000


**SERVERFARM**  
 Clarksville, AR



**LEVEL 1 - FIRE ALARM DETECTION PLAN**

**JOB SHEET** US0049903.5614

FA01-01

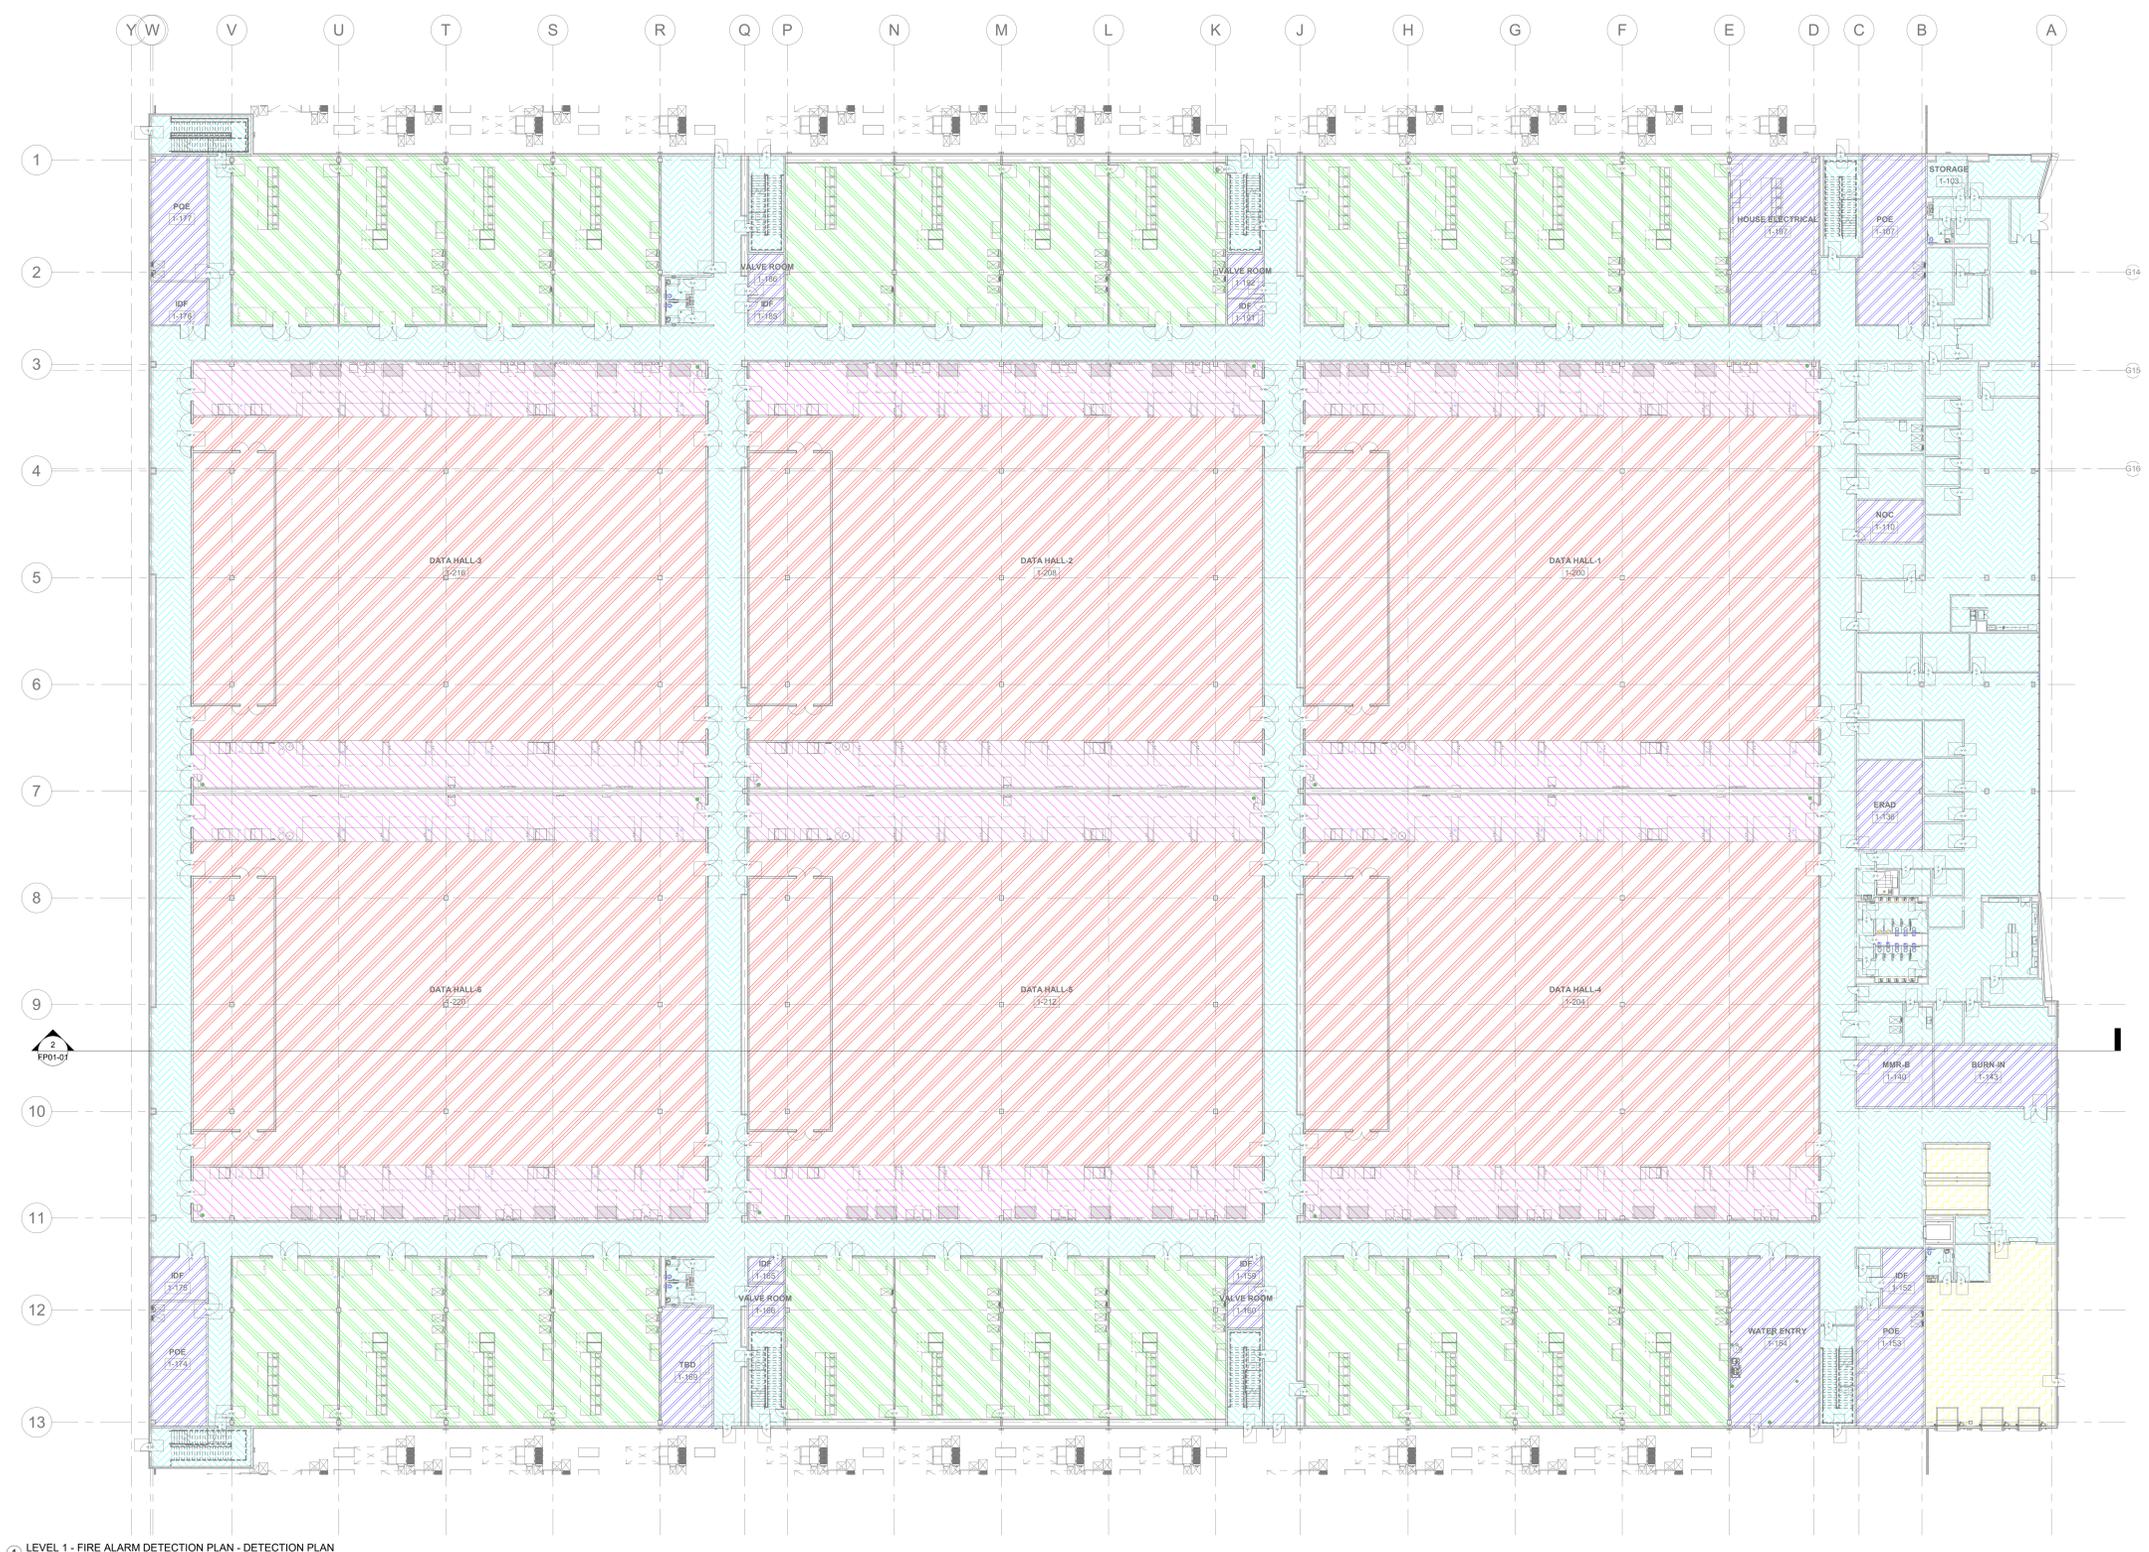

① LEVEL 1 - FIRE ALARM DETECTION PLAN - DETECTION PLAN  
 3/64" = 1'-0"

DEFERRED SUBMITTAL  
 ALL WORK SHOWN IS  
 TO ILLUSTRATE  
 DESIGN INTENT

1/23/2026 4:01:25 PM FA01-01 LEVEL 1 - FIRE ALARM DETECTION PLAN