

ZONE SCHEDULE - LEVEL TWO			
ZONE	SYSTEM TYPE	VALVE LOCATION	Gross Area
PA-02-01	DOUBLE INTERLOCK PREACTION SYSTEM	STORAGE 2-107	8953.13 SF
PA-02-02	DOUBLE INTERLOCK PREACTION SYSTEM	STORAGE 2-107	27239.17 SF
PA-02-03	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-145	27239.29 SF
PA-02-04	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-145	8975.76 SF
PA-02-05	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-113	9053.31 SF
PA-02-06	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-113	27224.11 SF
PA-02-07	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-145	27222.86 SF
PA-02-08	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-145	9069.13 SF
PA-02-09	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-119	8802.81 SF
PA-02-10	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-119	27224.11 SF
PA-02-11	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-139	27222.86 SF
PA-02-12	DOUBLE INTERLOCK PREACTION SYSTEM	VALVE ROOM 2-139	9045.22 SF
WET-02-01	WET PIPE SYSTEM	STORAGE 2-107	24393.25 SF
WET-02-02	WET PIPE SYSTEM	VALVE ROOM 2-119	15240.38 SF
WET-02-03	WET PIPE SYSTEM	VALVE ROOM 2-139	16016.56 SF


ISSUES	
1	
2	12.12.2025 SCHEMATIC DESIGN
3	01.23.2026 60% DESIGN DELIVERABLE

REVISIONS	

KW Mission Critical Engineering
 Contact: Stephan Slabicky Phone: 212.951.3943
 Engineer License #: Exp. Date:

NOT FOR CONSTRUCTION
 Date: 00/00/0000


SERVERFARM
 Clarksville, AR



LEVEL 2 - FIRE SUPPRESSION ZONING PLAN

JOB SHEET US0049903.5614

FP01-02

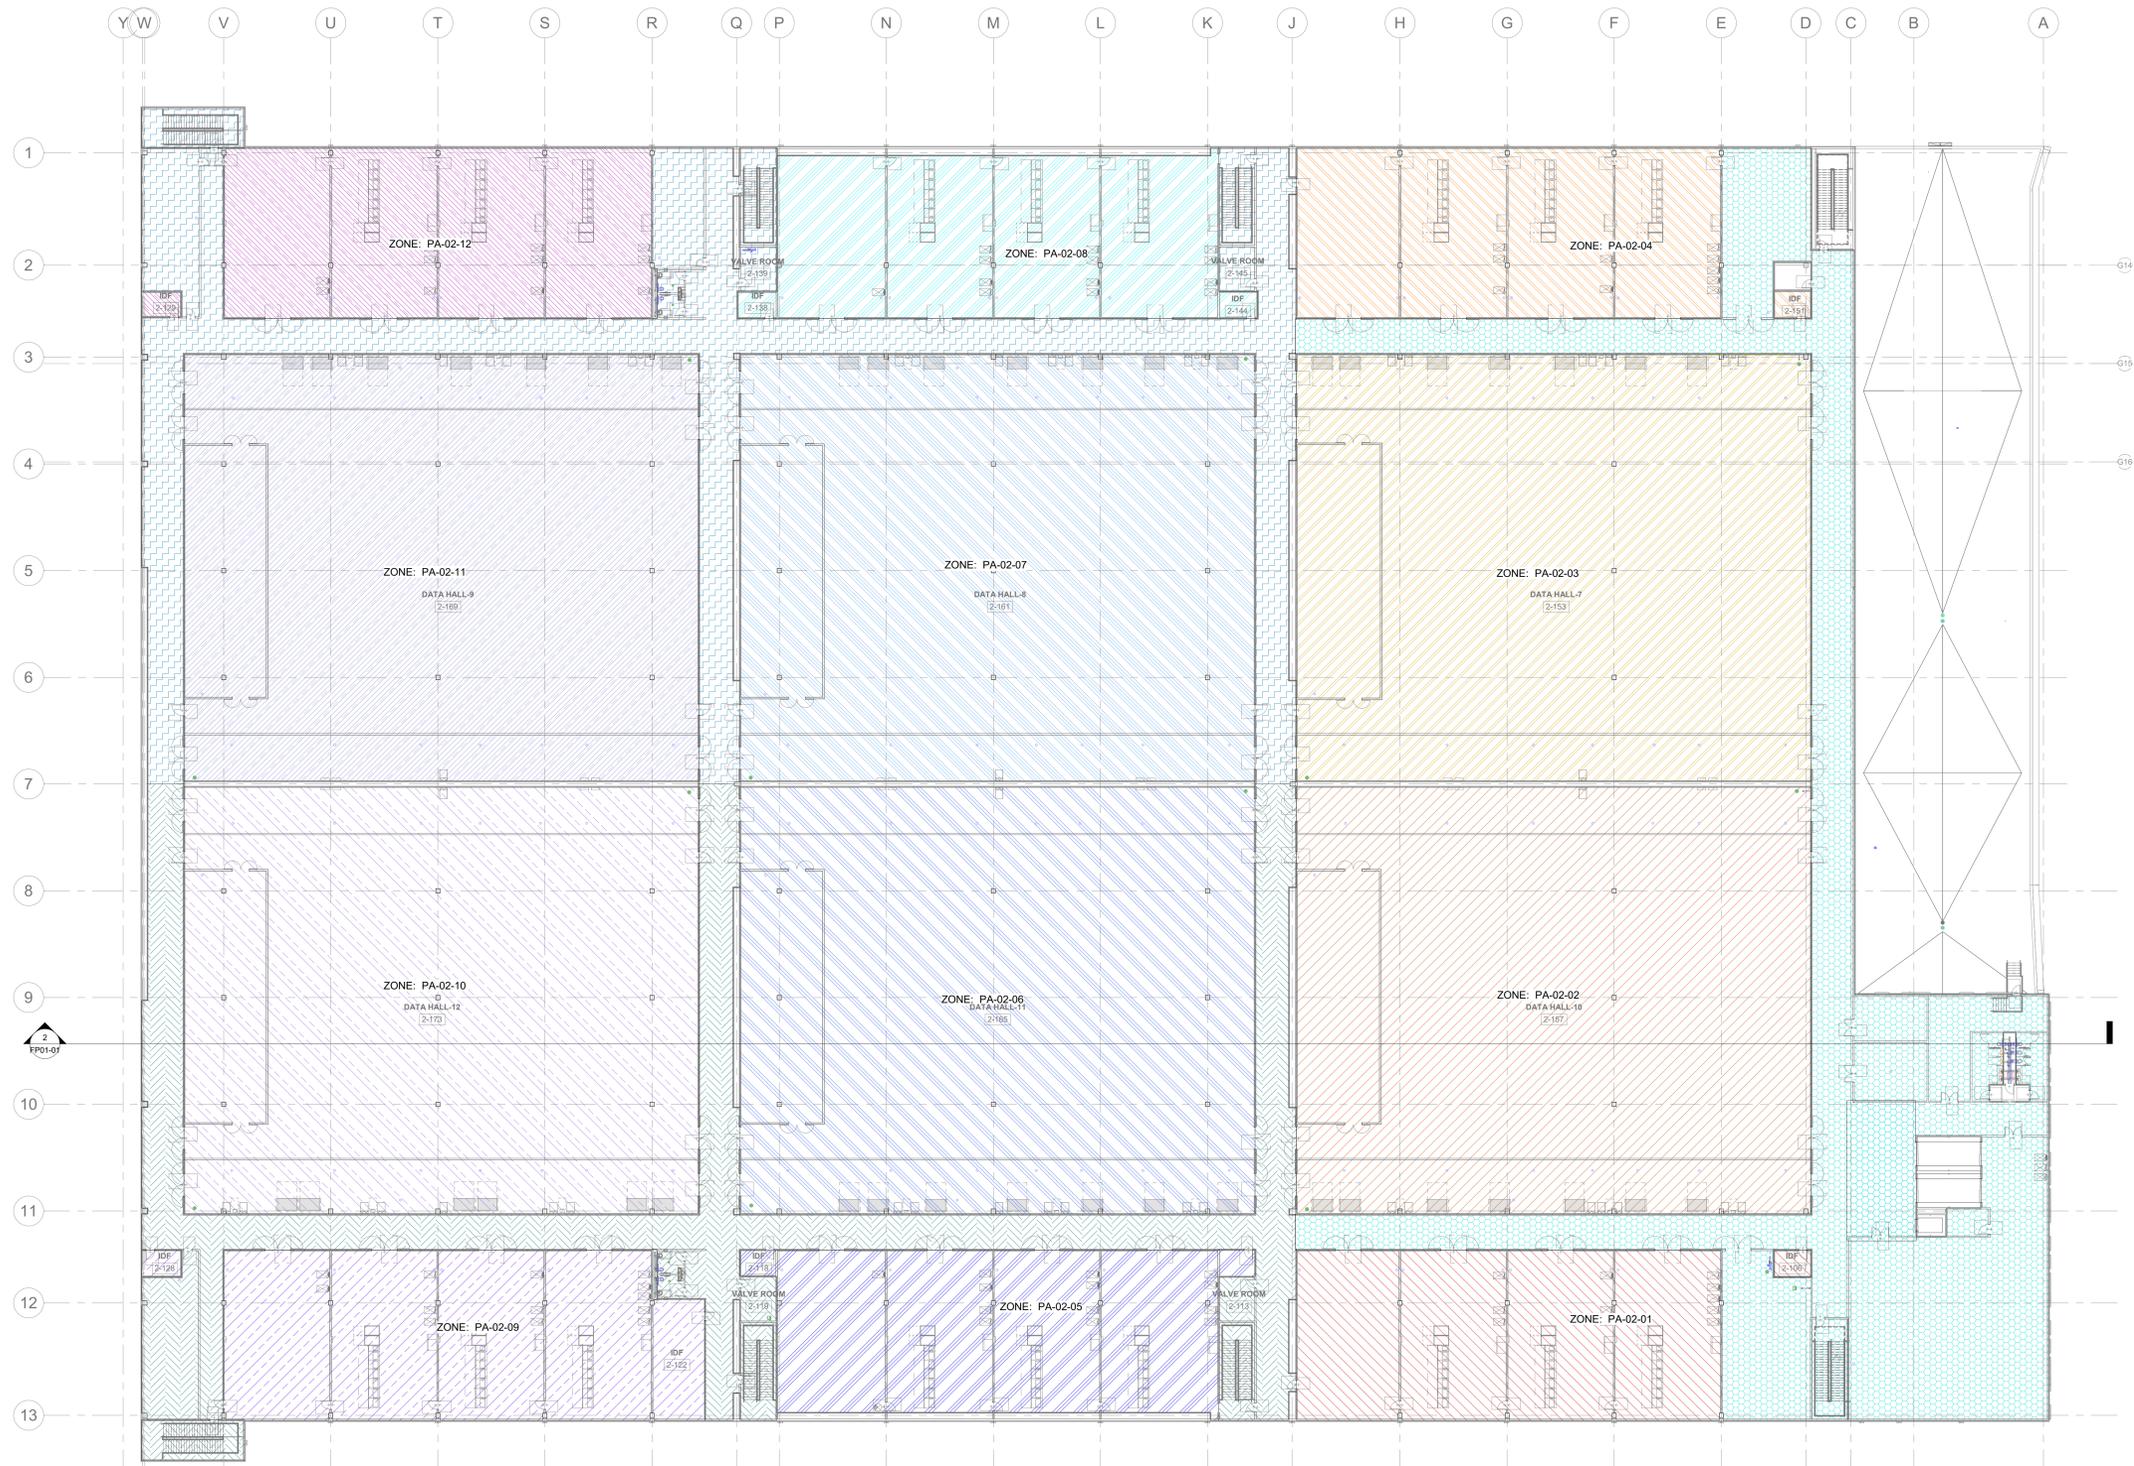

ZONING LEGEND

- WET-01-01
- WET-01-02
- WET-01-03
- WET-02-01
- WET-02-02
- WET-02-03
- PA-02-01
- PA-02-02
- PA-02-03
- PA-02-04
- PA-02-05
- PA-02-06
- PA-02-07
- PA-02-08
- PA-02-09
- PA-02-10
- PA-02-11
- PA-02-12

ZONE: WET-02-01

DEFERRED SUBMITTAL
 ALL WORK SHOWN IS
 TO ILLUSTRATE
 DESIGN INTENT

1/23/2026 3:56:25 PM FP01-02 LEVEL 2 - FIRE SUPPRESSION ZONING PLAN