
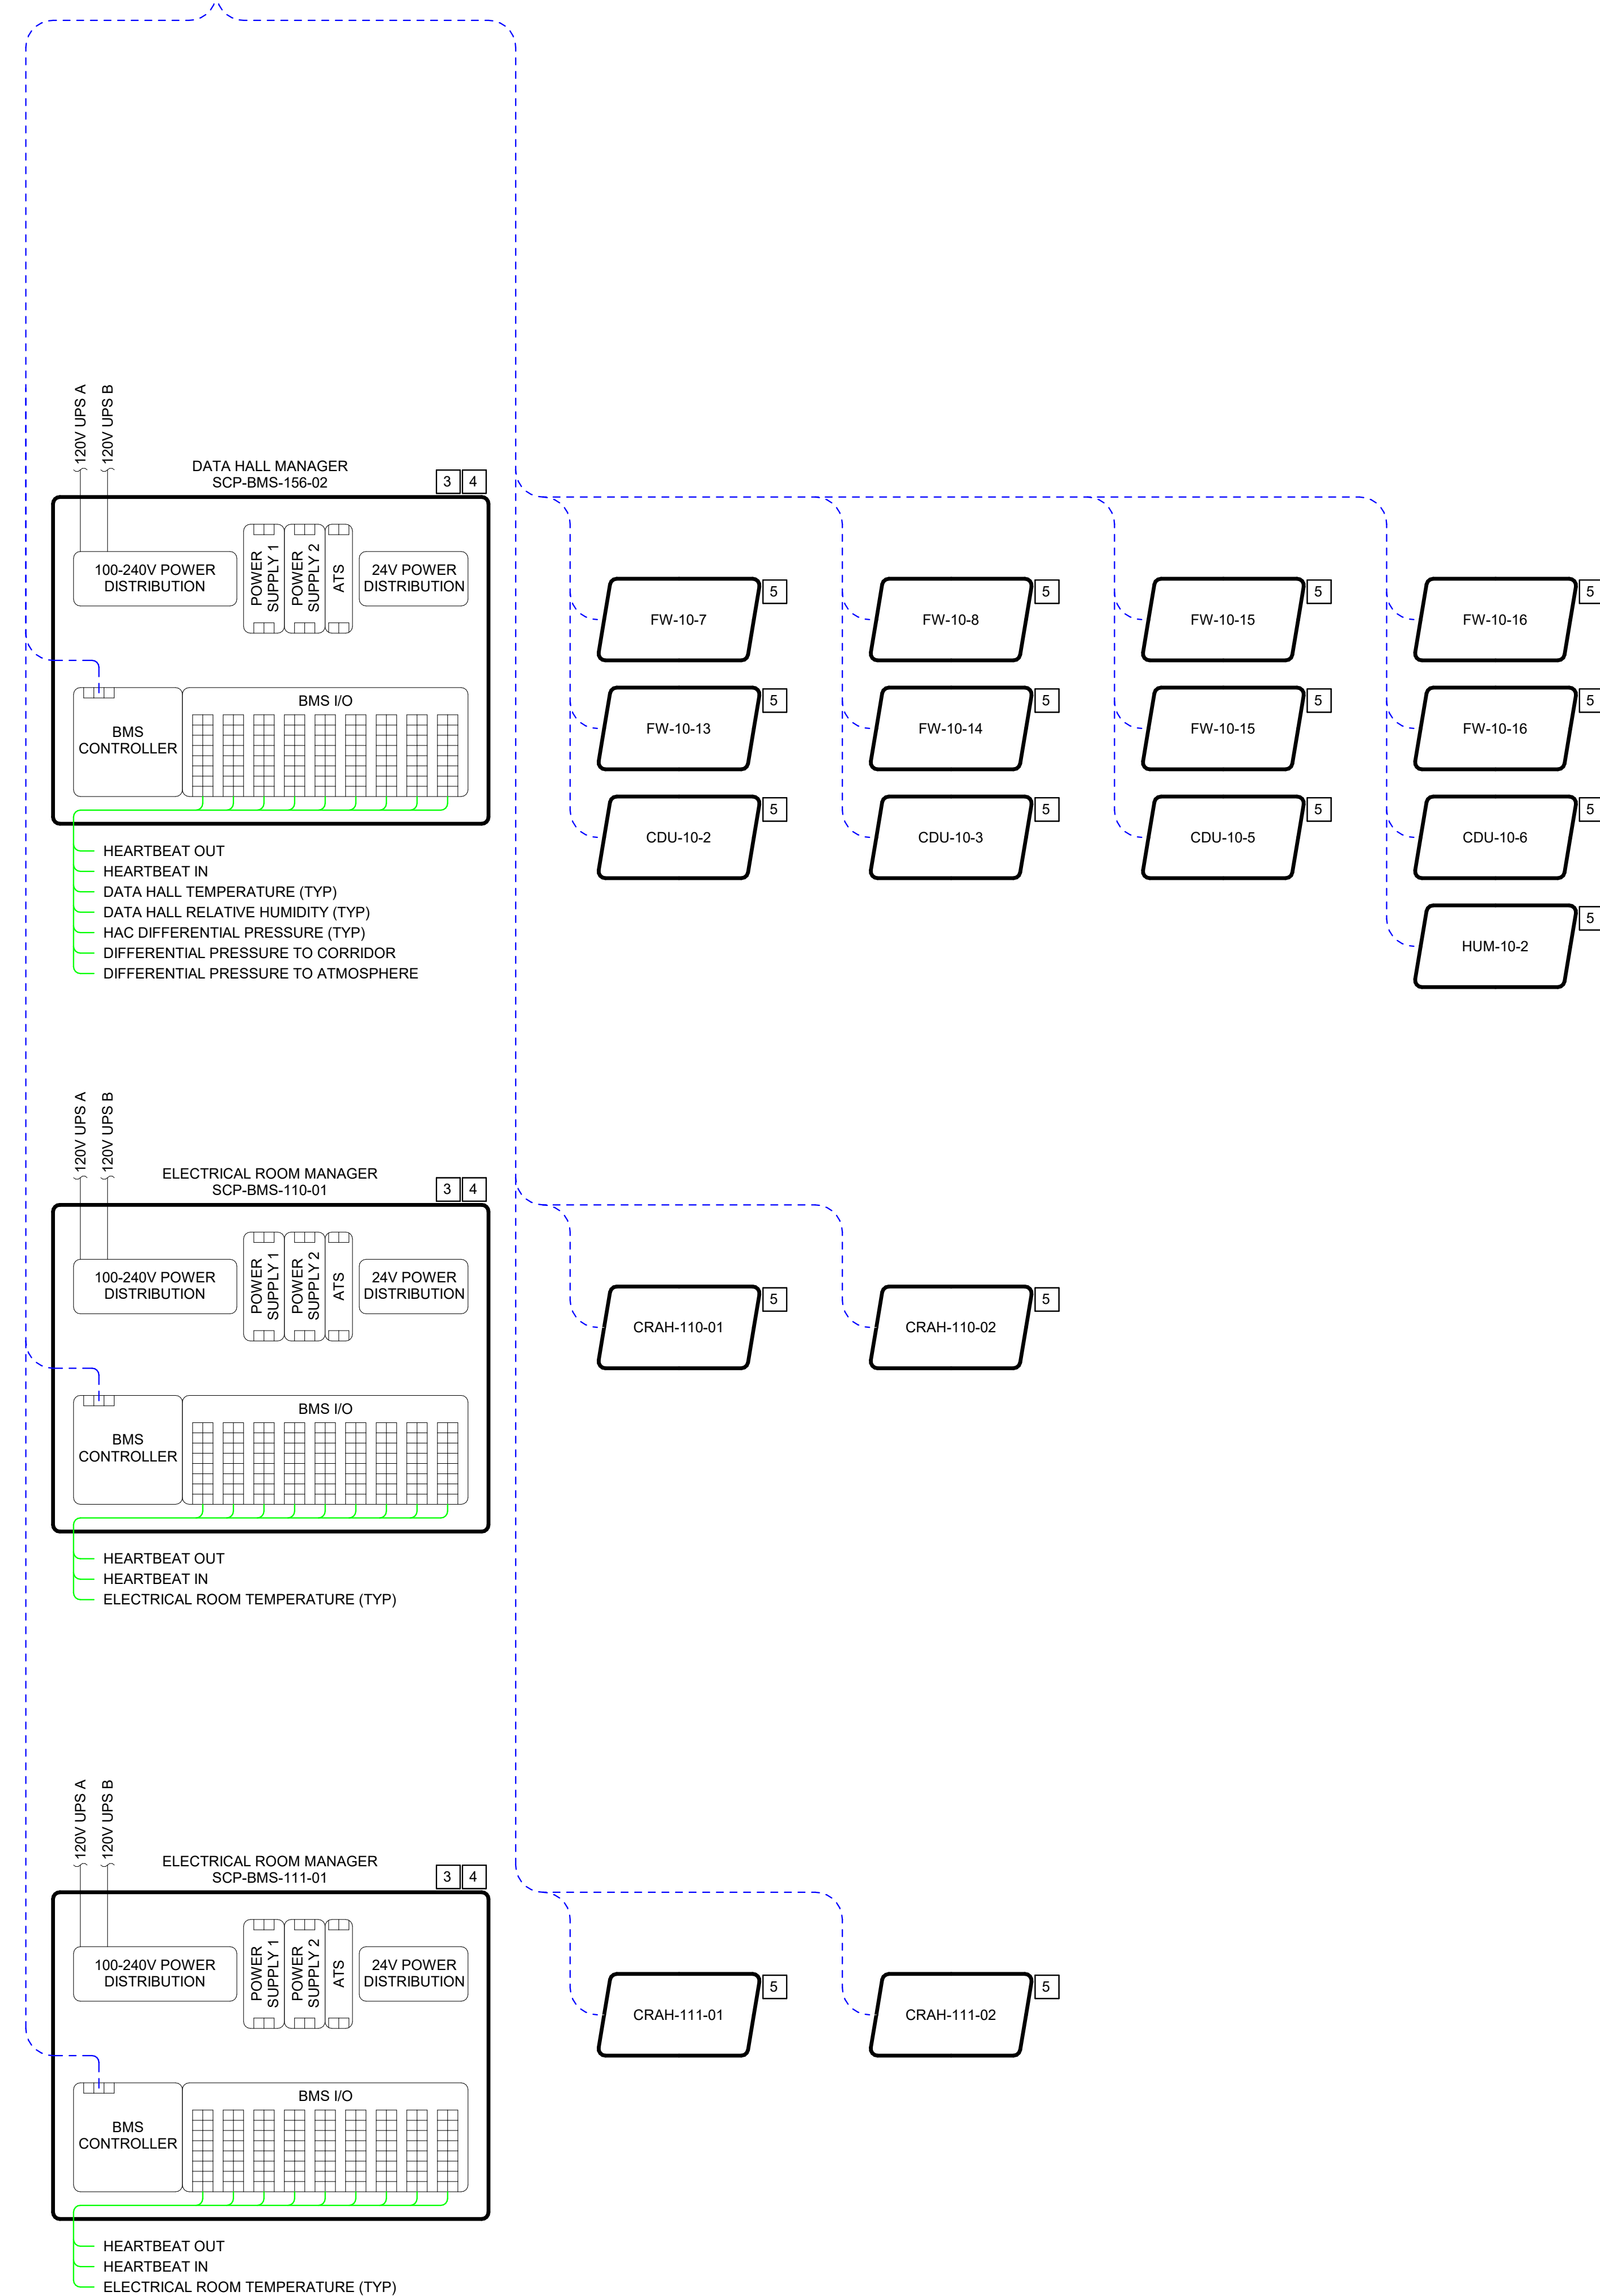
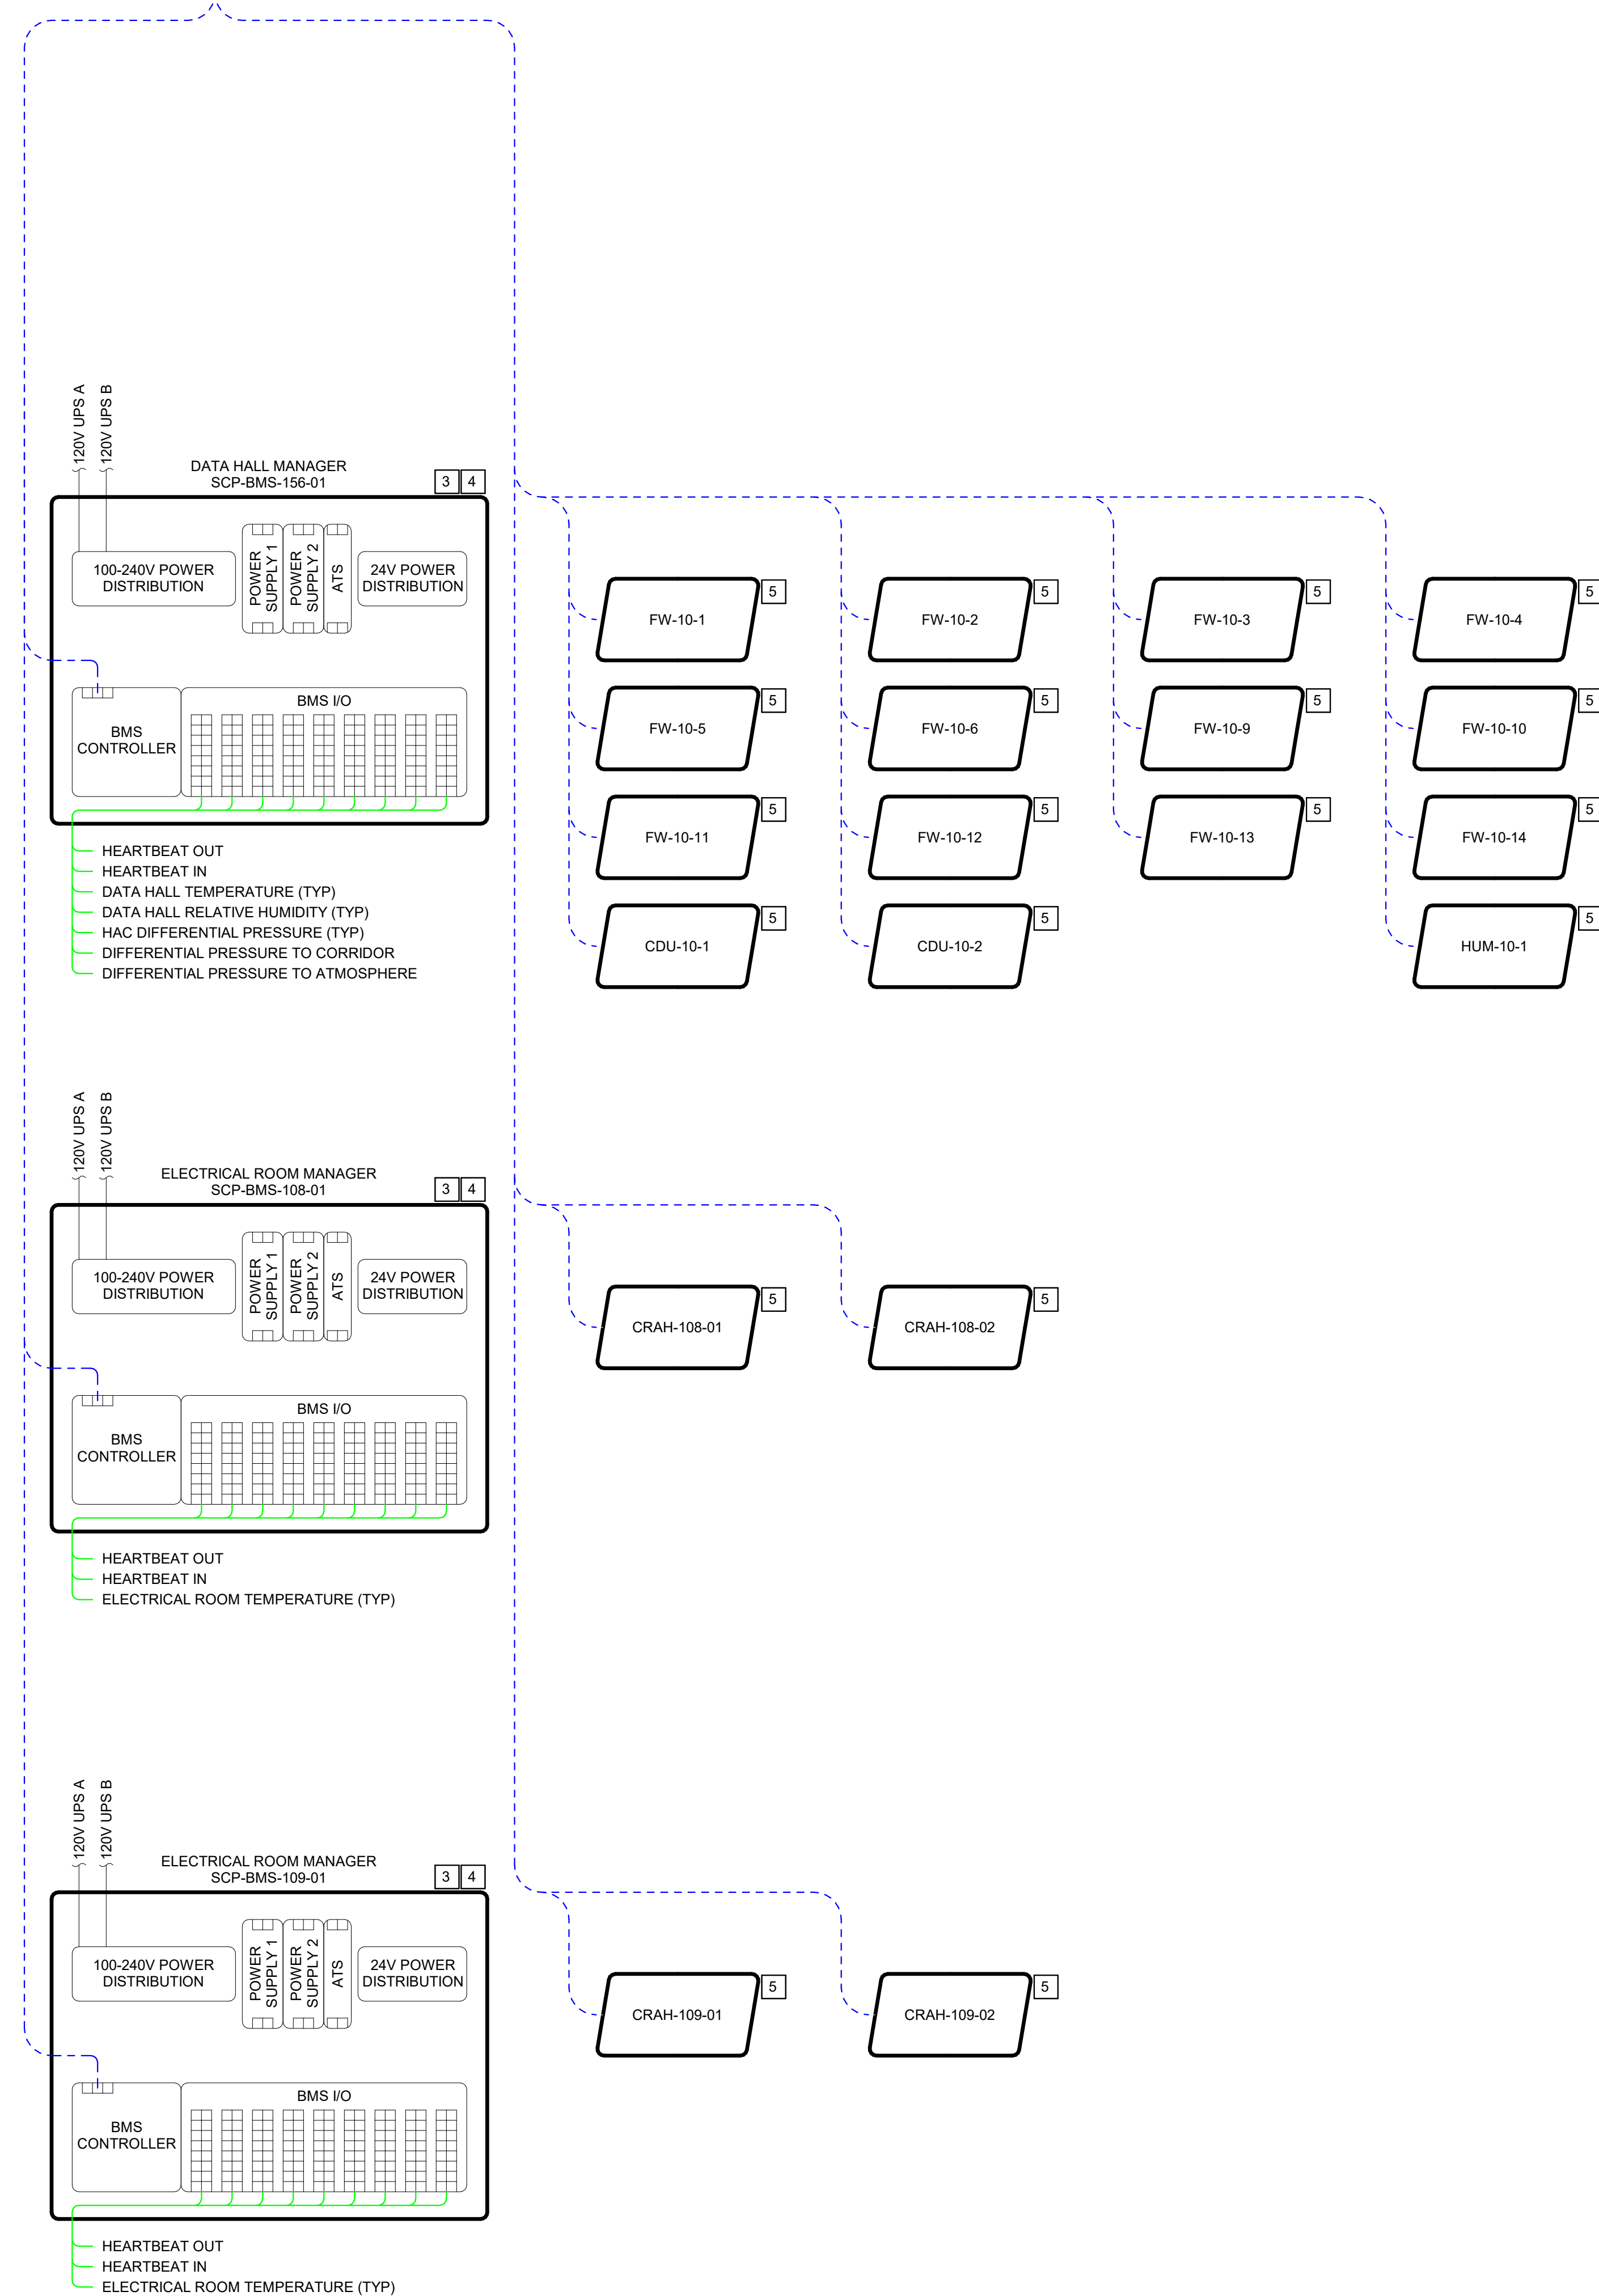
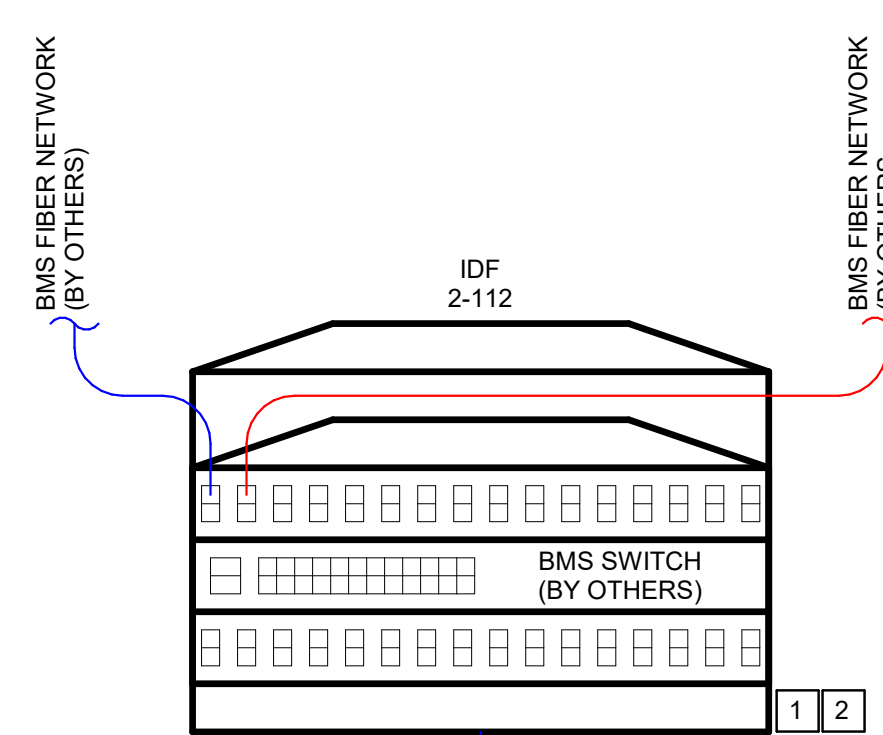


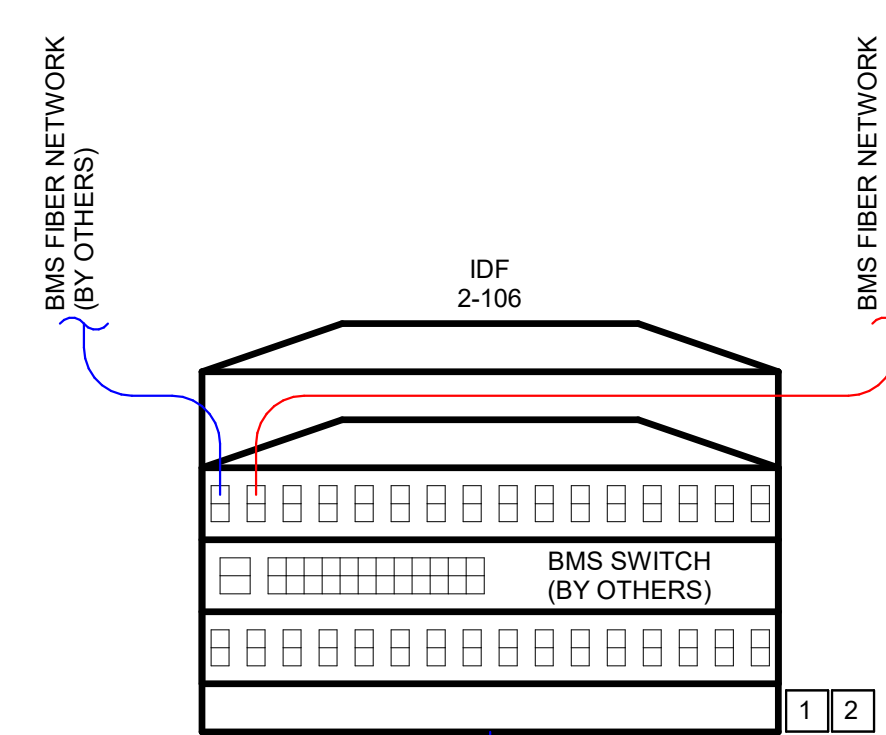

- ## GENERAL NOTES

1. CONTROLS CONTRACTOR TO PROVIDE PANEL MOUNTED POWER SUPPLY IN EACH BMS CONTROL PANEL.
2. LOSS OF COMMUNICATIONS BETWEEN BMS/EPMS AND EQUIPMENT SHALL TRIGGER AN ALARM AT THE OPERATOR WORKSTATION.
3. CONTROLS CONTRACTOR TO FURNISH AND INSTALL SUFFICIENT HARDWARE AND SOFTWARE CAPACITY TO ACCOMMODATE FUTURE EQUIPMENT IN THE DAY 1 BUILD.

KEYED NOTES

- [illegible]

[illegible][illegible]

kW Mission Critical Engineering
Contact: Alex Tate Phone: 404.829.8031
Engineer:
License #: Exp. Date:

NOT FOR CONSTRUCTION


SF - ARK01
DESIGN DEVELOPMENT
CLARKSVILLE, AR 72830

CONTROLS RISER
DIAGRAM - LEVEL
2 - DATA HALL 10


JOB US0049903.5614
SHEET

IC01-10

SHEET LEGEND AND SYMBOLS:

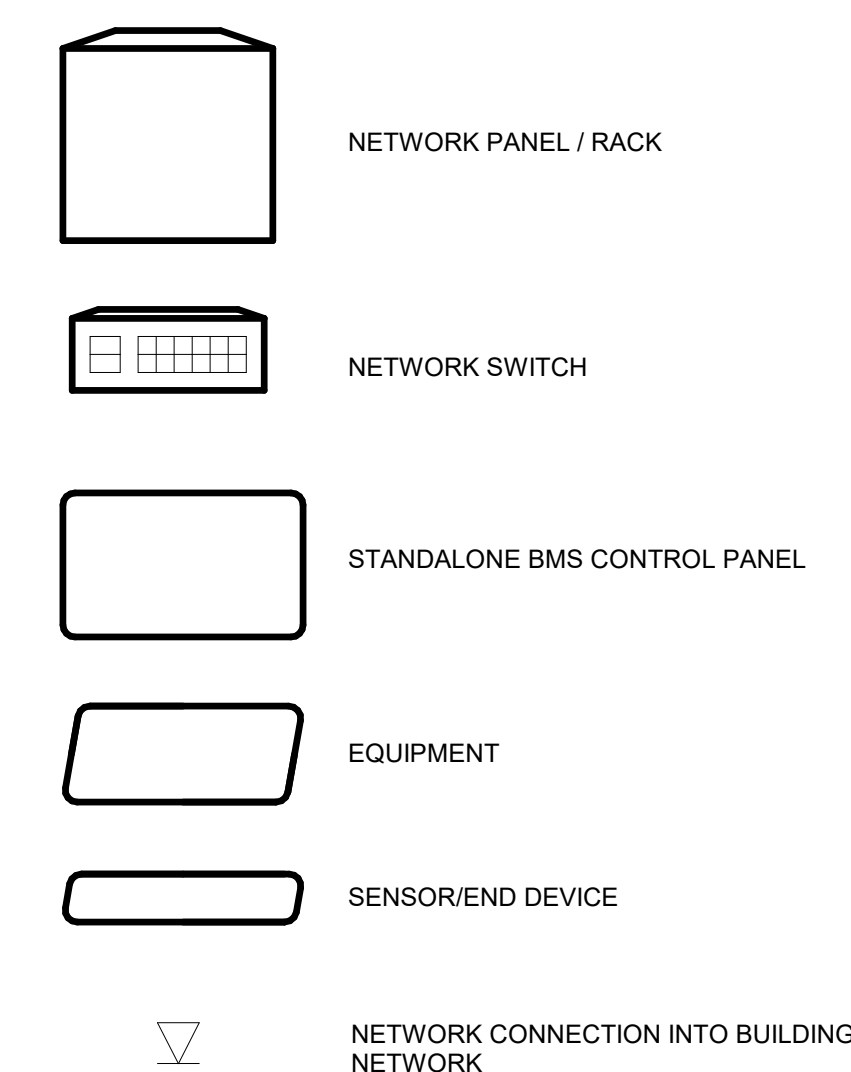

WIRING LEGEND:

- 
- Legend for interlock types:
- ETHERNET (Blue dashed line)
 - SINGLE-MODE FIBER LC/LC CONNECTORS (Green dashed line)
 - RS485 COMMUNICATION INTERLOCK (Black dashed line)
 - HARDWIRED INTERLOCK (Red solid line)
 - INTERLOCK WIRING BY CONTROLS CONTRACTOR (Black dotted line)
 - MANUFACTURER INTERLOCK (Black dashed line)
 - 120VAC WIRING BY OTHERS INTERLOCK (Black solid line)