



REFER TO SPECIFICATION 23 09 00 FOR CONTROLS
RELATED INSTALLATION REQUIREMENTS

REFER TO SPECIFICATION 23 09 00 FOR SEQUENCE OF
OPERATIONS

REFER TO ELECTRICAL PROJECT SPECIFICATIONS FOR
ALL WIRING INSTALLATION REQUIREMENTS

INSTALL FLEXIBLE CONNECTIONS IN RUNS OF
RACEWAYS, CABLES, WIREWAYS, CABLE TRAYS AND
FLEXIBLE CONDUITS. FLEXIBLE JOINTS, JOINTS,
SEISMIC JOINTS, ARE OR SUBJECT TO STRUCTURAL
DEFLECTIONS OR INTERSTORY DRIFT SUPPORTS
FLEXIBLE CONNECTIONS SHALL BE INSTALLED WHERE
ADDITIONAL SECTIONS OF RACEWAYS ARE SUPPORTED
BY STRUCTURAL MEMBERS OR WHERE THERE
THEY TERMINATE TO EQUIPMENT THAT IS ANCHORED
OR OTHERWISE ATTACHED TO A RIGID STRUCTURAL
ELEMENT. CONTRACTOR SHALL COORDINATE WITH
STRUCTURAL ENGINEER AND ARCHITECT TO DETERMINE
IN ORDER TO PROVIDE THE REQUIRED FLEXIBLE
CONNECTIONS.

CONTRACTOR SHALL COORDINATE INSTALLATION
ACTIVITIES WITH OTHER CONTRACTORS AND OTHER
TRADES AS NEEDED. THIS INCLUDES COORDINATING
WITH THE ELECTRICAL CONTRACTOR TO DETERMINE
WITH OWNER PER TO INCORPORATE ANY TYPICAL
REQUIREMENTS FOR SENSORS.

INSTALLATION OF ALL THERMOSTATS AND DIFFERENTIAL
THERMAL SWITCHES SHALL BE COORDINATED WITH
OTHER TRADES AND DEVICES FOR INSTALLATION HEIGHT
AFTER FINISHED FLOOR.

CONTROL PANELS ARE FED FROM TWO SEPARATE
120V CIRCUITS

PROVIDE FIELD COORDINATION WITH SYSTEM
INTEGRATOR ON ALL PANELS.

CONTROLS AND ELECTRICAL CONTRACTORS TO
COORDINATE ALL ETHERNET COPPER AND FIBER
CABLE ROUTING AND INSTALLATION

[illegible][illegible][illegible]


NOT FOR CONSTRUCTION

Date: 01/23/2026

SF - ARK01
DESIGN DEVELOPMENT
CLARKSVILLE, AR 72830

L	K	J
G	E	C
H	F	D
P	N	M

IC02-01E

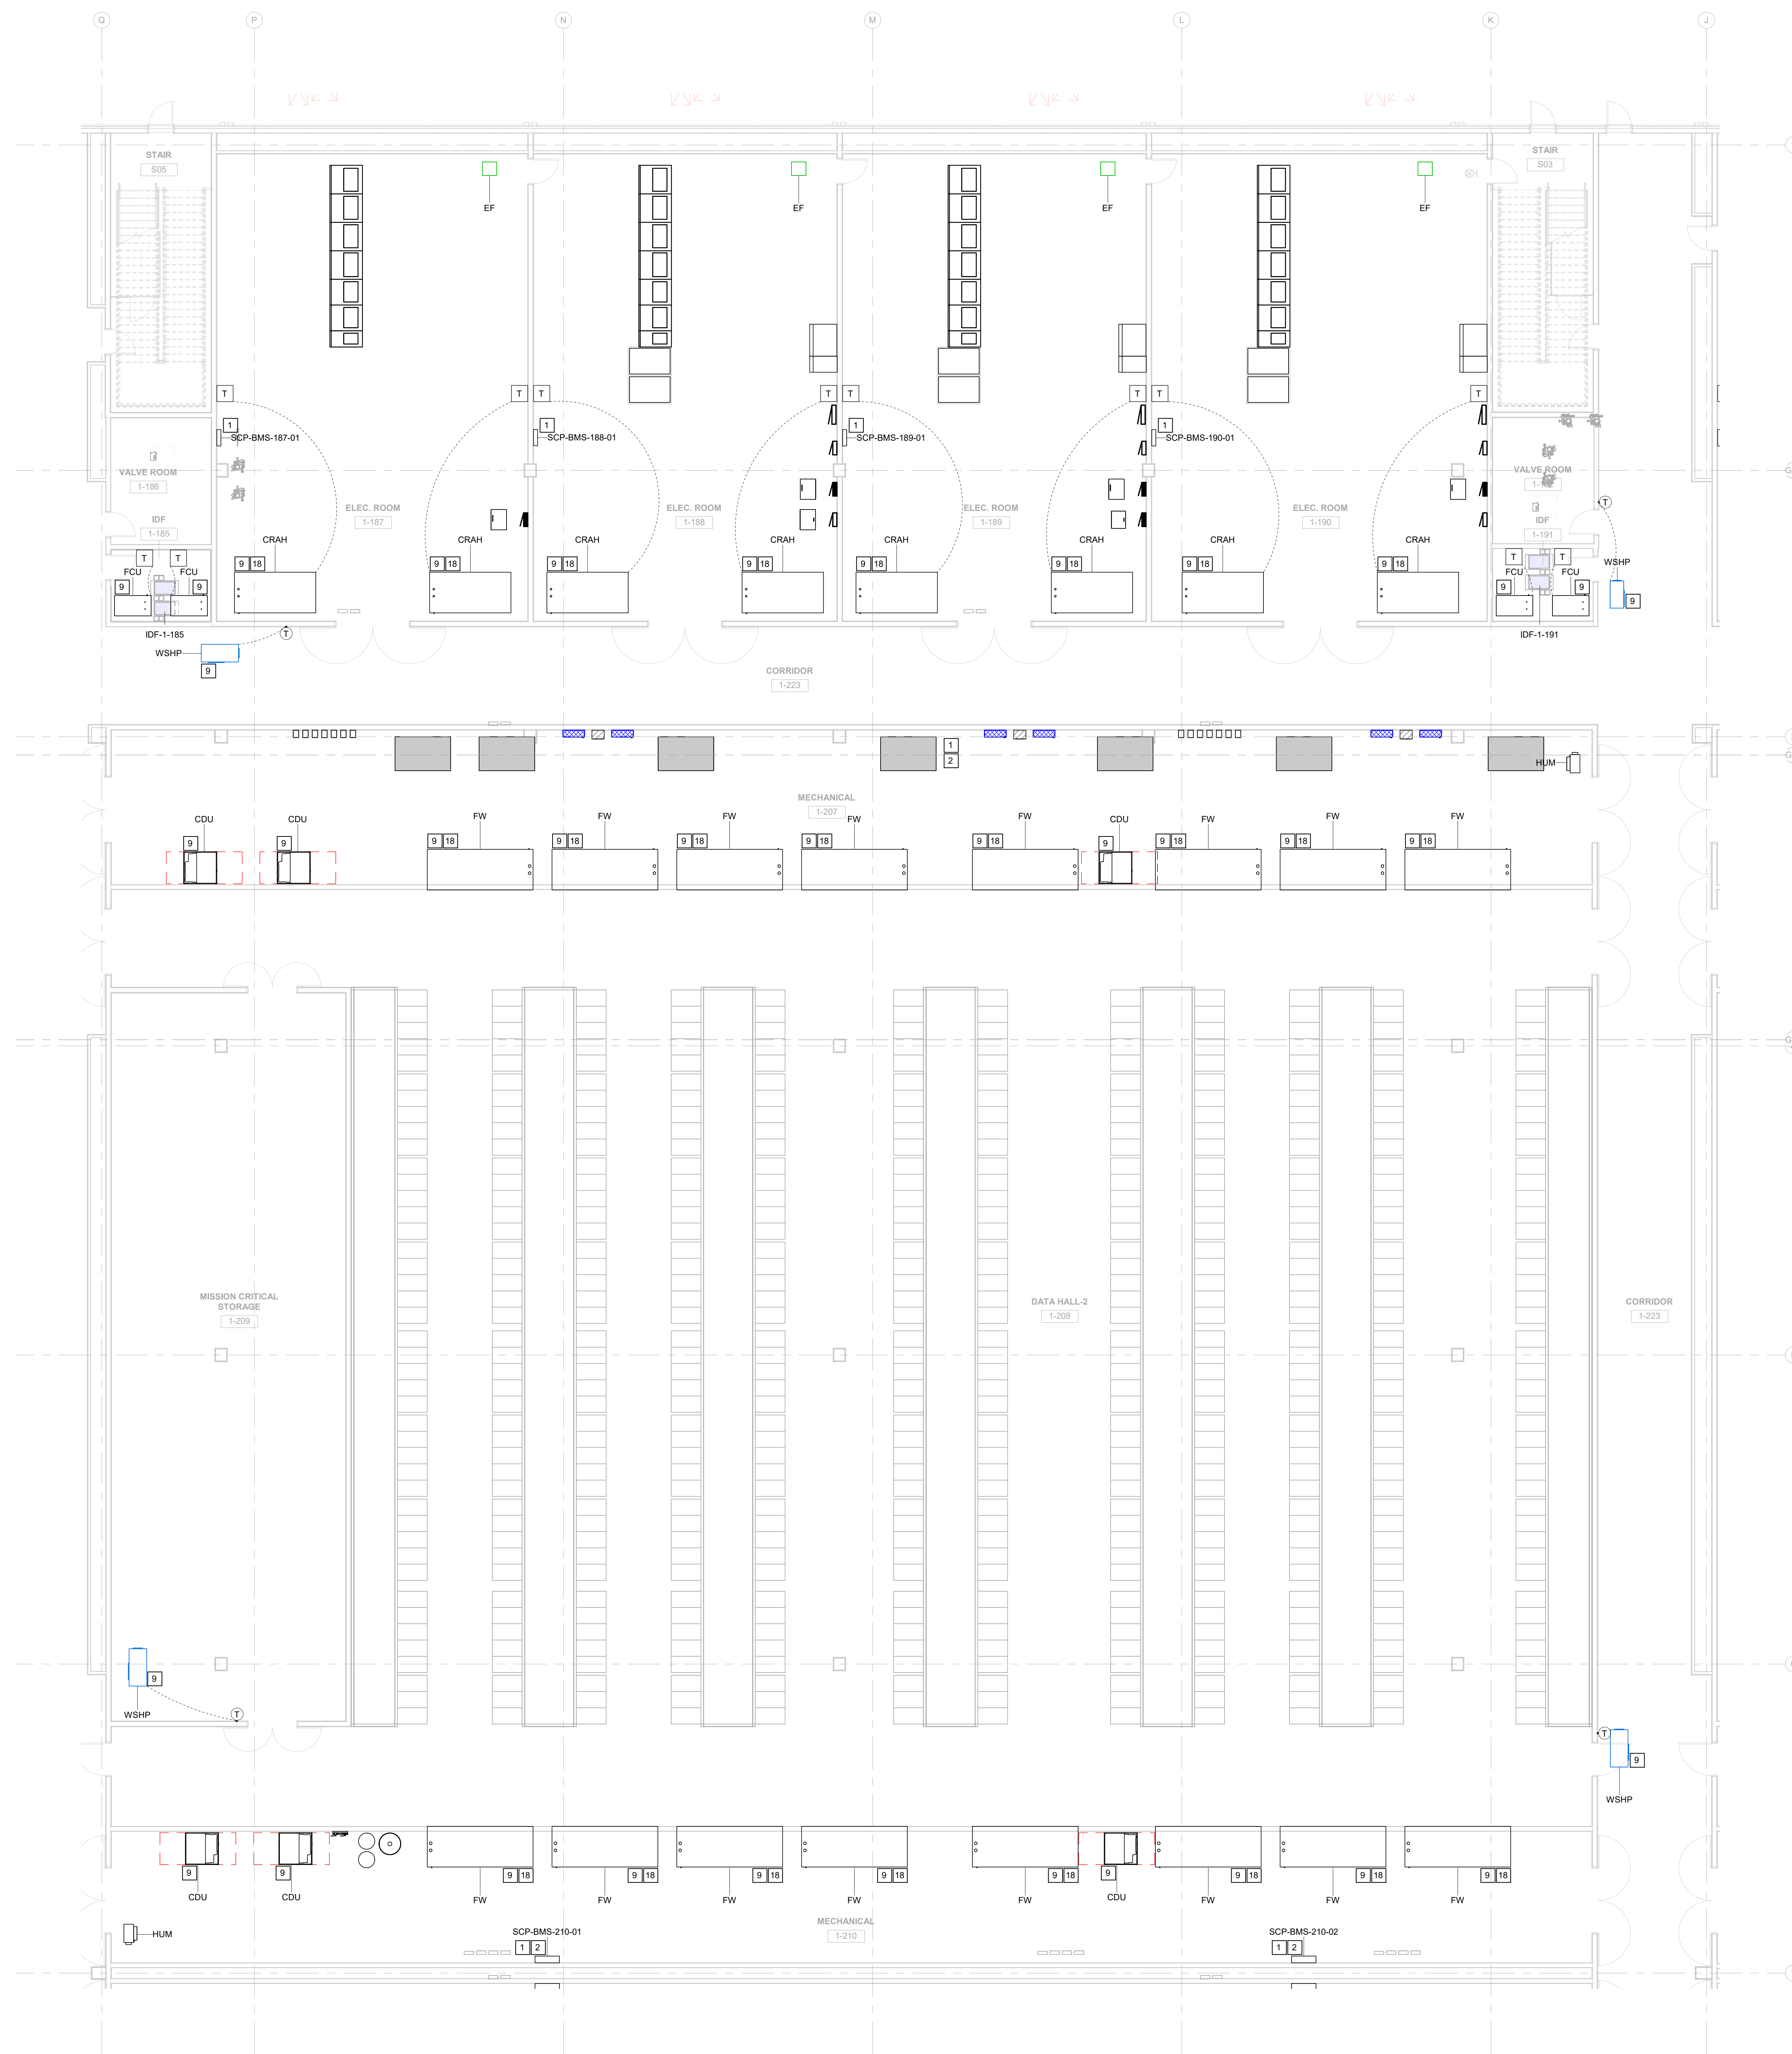

1 LEVEL 1 - CONTROLS PLAN - SEGMENT E
1/8" = 1'-0"