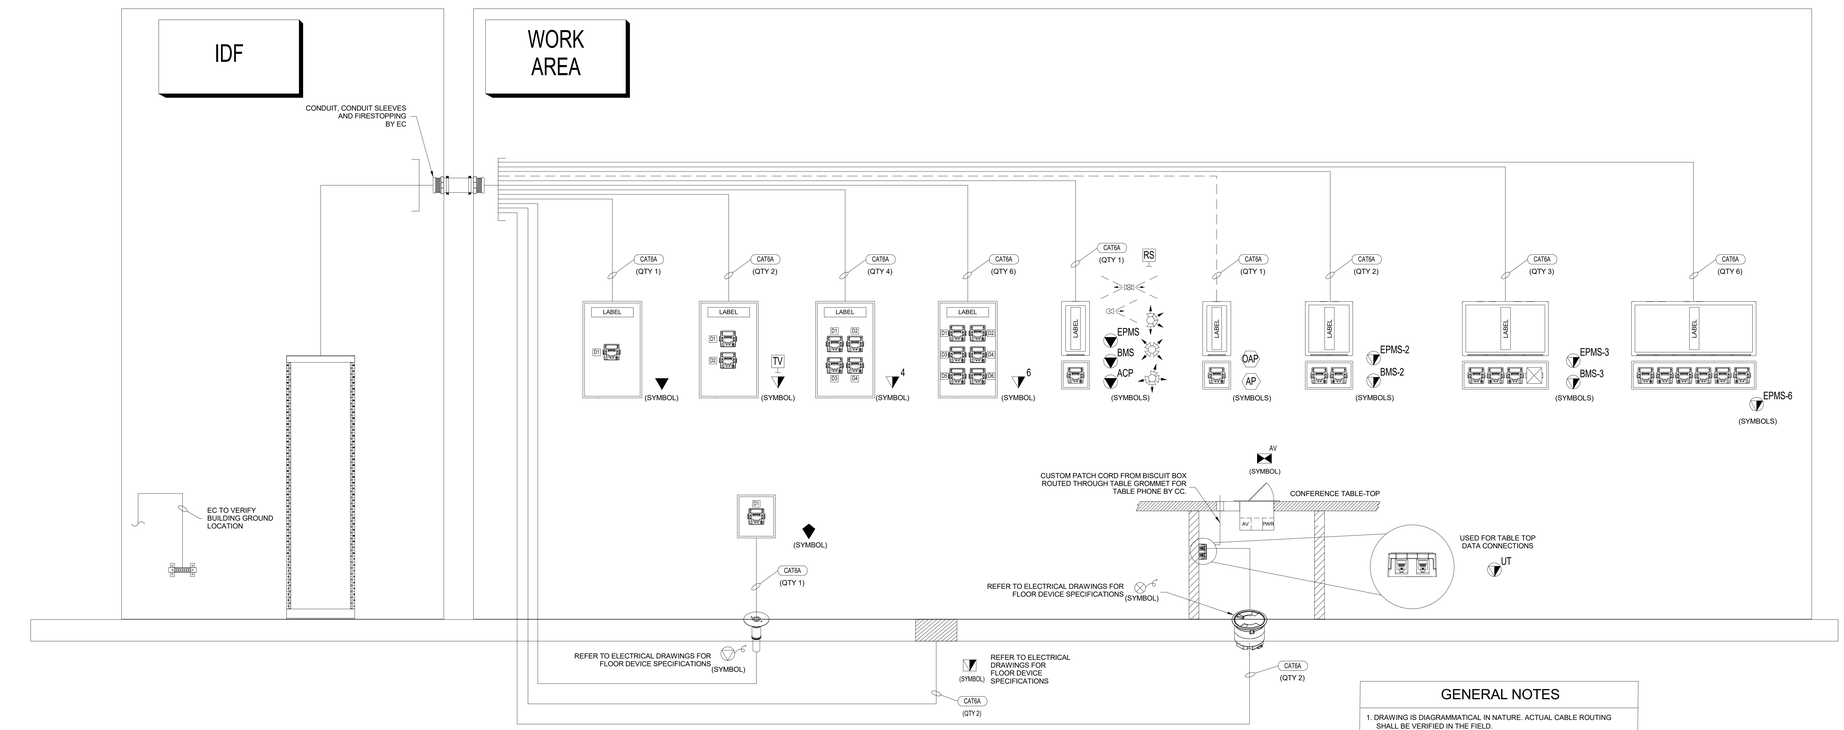

GENERAL NOTES

1. DRAWING IS DIAGRAMMATICAL IN NATURE. ACTUAL CABLE ROUTING SHALL BE VERIFIED IN THE FIELD.
2. CC SHALL PROVIDE INDOOR/OUTDOOR RATED CABLING AS REQUIRED.
3. CC SHALL PROVIDE PLENUM/RISER RATED CABLING AS REQUIRED.

1 CONNECTIVITY DIAGRAM
SCALE : NONE

serverfarm
CORGAN
TGRWA STRUCTURAL ENGINEERS
kW Mission Critical Engineering Member of WSP
EP ENGINEERING PLUS
Kimley»Horn

ISSUES		
1	12/12/2025	SCHEMATIC DESIGN
2	01/23/2026	DESIGN DEVELOPMENT
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		

REVISIONS		
1	01/23/26	ISSUE FOR DD

CORGAN
#1300, 20 N. Orange Ave., Orlando, 32801
214.244.8263
www.corgan.com

Serverfarm - ARK1 - Technology
ISSUE FOR DD
CLARKSVILLE, AR

TECHNOLOGY CONNECTIVITY DIAGRAM

JOB 27583
SHEET

T06-01

1/23/2026 8:25:16 PM T06-01 TECHNOLOGY CONNECTIVITY DIAGRAM

©2025, Engineering Plus L.L.C. These documents, whether printed or in digital or electronic format, are instruments of service for use solely with respect to this project. Engineering Plus retains all rights including copyrights. To the extent that the documents contain trade secrets and proprietary information, they are confidential and cannot be copied or disseminated to third parties without prior written permission. No license, right to reproduce or use of these documents is granted or implied unless incorporated in a prior written agreement with Engineering Plus L.L.C.