

LABEL INSTALLATION NOTES:
1. LABEL MATERIAL: LABEL MUST BE MADE OF BRASS
2. LABEL LOCATION: LABEL MUST BE ATTACHED TO CONDUIT WITHIN 6" OF CONDUIT CAP
3. LABEL TEXT: LABEL TEXT MUST BE ALL CAPS, BOLD ARIAL FONT, FONT SIZE MUST BE 5/16" TALL MINIMUM. LABEL MUST BE (2) LINES:TOP LINE: ORIGIN ROOM. BOTTOM LINE: DESTINATION ROOM.CONDUIT UNIQUE #
4. LABEL PLATE: THE PLATE MUST BE BRASS WITH EMBOSSED LETTERS
5. LABELS ARE REQUIRED FOR ALL TELECOM POINT-TO-POINT OSP AND ISP CONDUITS WHERE CONDUIT DESTINATION IS OUT OF VIEW OF CONDUIT ORIGIN
6. CONTRACTOR TO SUBMIT LABELING SCHEME AND SAMPLE LABEL TO OWNER AND ENGINEER FOR APPROVAL PRIOR TO PROCUREMENT AND INSTALL

1 **CONDUIT LABEL DETAIL**
SCALE : NONE

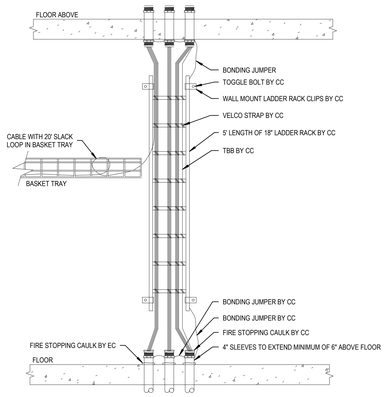

2 **VERTICAL CABLING SUPPORT DETAIL**
SCALE : NONE

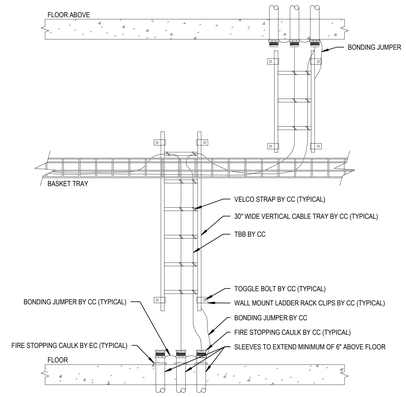

3 **OFFSET VERTICAL CABLING SUPPORT DETAIL**
SCALE : NONE

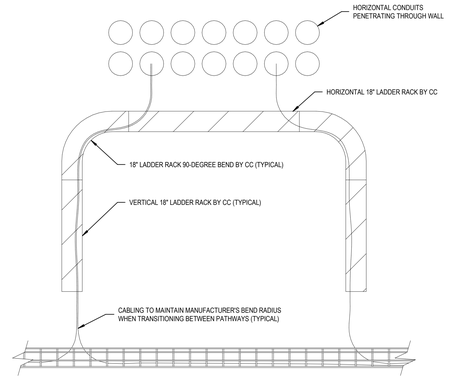

4 **MDF/POE CONDUIT TO BASKET TRAY PATHWAY DETAIL**
SCALE : NONE



NOTE: CONDUIT BY EC. CONDUIT SHALL EXTEND TO NEARBY BASKET TRAY SO CABLES CAN DROP DIRECTLY INTO BASKET TRAY. CONDUIT MUST TERMINATE 6" TO 8" DIRECTLY ABOVE BASKET TRAY

5 **HORIZONTAL CONDUIT TO BASKET TRAY DETAIL**
SCALE : NONE

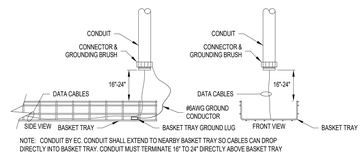

NOTE: CONDUIT BY EC. CONDUIT SHALL EXTEND TO NEARBY BASKET TRAY SO CABLES CAN DROP DIRECTLY INTO BASKET TRAY. CONDUIT MUST TERMINATE 16" TO 24" DIRECTLY ABOVE BASKET TRAY

6 **VERTICAL CONDUIT TO BASKET TRAY DETAIL**
SCALE : NONE

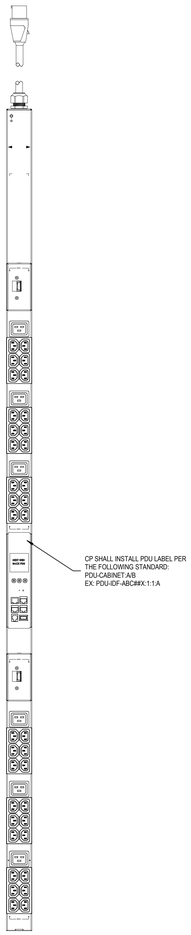

7 **TYPICAL VERTICAL PDU**
SCALE : NONE

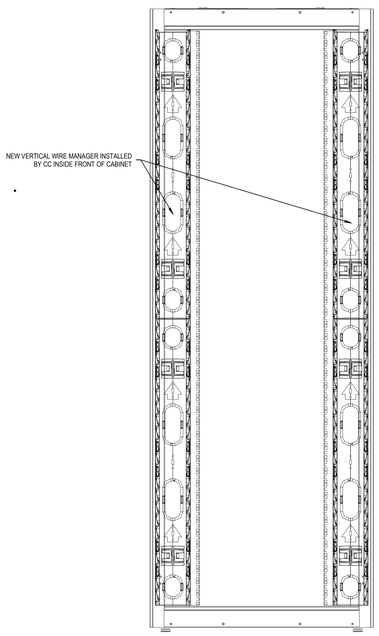

8 **CABINET VERTICAL WIRE MANAGER INSTALLATION**
SCALE : NONE

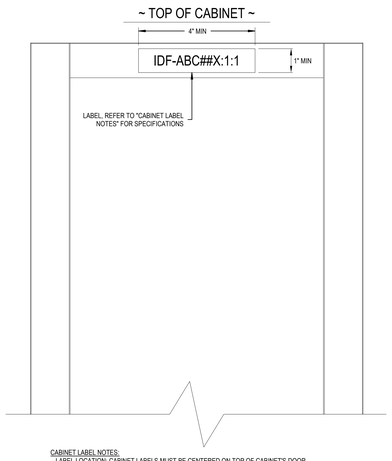

CABINET LABEL NOTES:
- LABEL LOCATION: CABINET LABELS MUST BE CENTERED ON TOP OF CABINET'S DOOR
- LABEL TEXT: LABEL TEXT MUST BE ALL CAPS, BOLD ARIAL FONT, FONT SIZE MUST BE 3/4" TALL MINIMUM. ORIENTED HORIZONTALLY
- LABEL COLOR: ALL TEXT MUST BE ETCHED WHITE WITH A BLACK BACKGROUND
- LABEL PLATE: THE PLATE SHALL BE PLASTIC BLACK WITH WHITE CORE
- ALL MDF/POE/DAS CABINETS SHALL HAVE THIS LABEL INSTALLED ON THE CABINET'S FRONT DOOR
- ALL IDF CABINETS SHALL HAVE THIS LABEL INSTALLED ON THE CABINET'S FRONT AND REAR DOORS
- "IDF-ABC##X:1:1" IS A GENERIC LABEL. REFER TO CABINET ELEVATIONS FOR CORRECT CABINET LABELS

9 **CABINET LABELING DETAIL**
SCALE : NONE

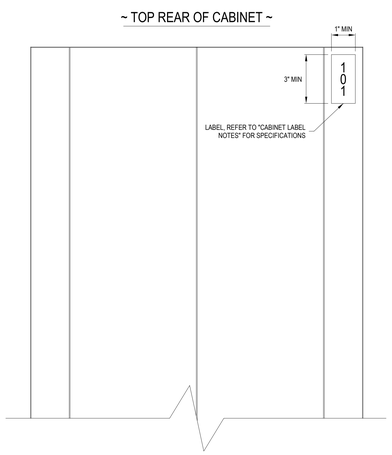

CABINET LABEL NOTES:
- LABEL LOCATION: CABINET LABELS MUST BE CENTERED ON TOP OF CABINET'S RIGHT DOOR
- LABEL TEXT: LABEL TEXT MUST BE ALL CAPS, BOLD ARIAL FONT, FONT SIZE MUST BE 3/4" TALL MINIMUM. ORIENTED VERTICALLY
- LABEL COLOR: ALL TEXT MUST BE ETCHED WHITE WITH A BLACK BACKGROUND
- LABEL PLATE: THE PLATE SHALL BE PLASTIC BLACK WITH WHITE CORE
- ALL MDF/POE/DAS CABINETS SHALL HAVE THIS LABEL INSTALLED ON THE CABINET'S REAR DOOR
- "101" IS A GENERIC LABEL. REFER TO CABINET ELEVATIONS FOR CORRECT CABINET LABELS

10 **SPLIT REAR DOOR CABINET LABELING DETAIL**
SCALE : NONE

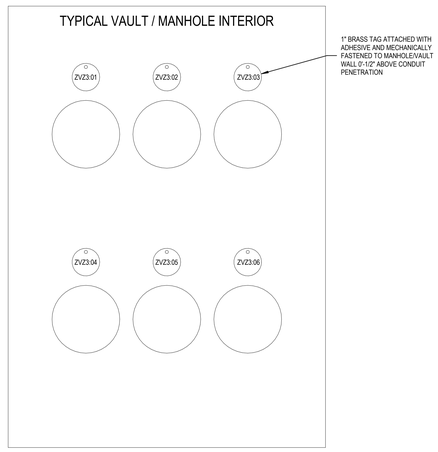

NOTES:
1. BRASS LABELS SHALL BE PERMANENTLY ENGRAVED WITH CONDUIT DESIGNATION.
2. CONTRACTOR TO PROVIDE BRASS LABEL MARK-UP FOR ENGINEER AND OWNER FOR APPROVAL PRIOR TO PROCUREMENT AND INSTALLATION.
3. "ZV23:##" IS A GENERIC LABEL. CONTRACTOR TO CONFIRM CONDUIT LABEL WITH CONDUIT SCHEDULES.

11 **MANHOLE/VAULT TERMINATION LABELING DETAIL**
SCALE : NONE

serverfarm
CORGAN
TGRWA STRUCTURAL ENGINEERS
kW Mission Critical Engineering Member of WSP
EP ENGINEERING PLUS
Kimley»Horn

ISSUES		
1	12/12/2025	SCHEMATIC DESIGN
2	01/23/2026	DESIGN DEVELOPMENT
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		

REVISIONS		
1	01/23/26	ISSUE FOR DD

CORGAN
#1300, 20 N. Orange Ave., Orlando, 32801
214.244.8263
www.corgan.com

Serverfarm - ARK1 - Technology
ISSUE FOR DD
CLARKSVILLE, AR

TECHNOLOGY DETAIL SHEET

JOB 27583
SHEET

T07-04

1/23/2026 8:25:19 PM T07-04 TECHNOLOGY DETAIL SHEET

©2025, Engineering Plus L.L.C. These documents, whether printed or in digital or electronic format, are instruments of service for use solely with respect to this project. Engineering Plus retains all rights including copyrights. To the extent that the documents contain trade secrets and proprietary information, they are confidential and cannot be copied or disseminated to third parties without prior written permission. No license, right to reproduce or use of these documents is granted or implied unless incorporated in a prior written agreement with Engineering Plus L.L.C.